



# Kenya Power

Central Office – P.O. Box 30099, Nairobi, Kenya  
Telephone – 254-02-3201000  
Fax No. 254-02-3514485  
Stima Plaza, Kolobot Road

**Our Ref:** KP1/9A.3/OT/18/19-20/JM/hm

8th January 2020

TO:

ALL PROSPECTIVE BIDDERS

**1. RE: ADDENDUM NO.4 TO THE TENDER NO. KP1/9A.3/OT/18/19-2019 FOR SUPPLY OF CIRCUIT BREAKERS, SWITCHBOARD PANELS AND 11KV METERING PANELS**

Please refer to the above tender.

We make the following amendments to the above Principal Tender Document (hereinafter abbreviated as the PTD) for the Supply and delivery of circuit breakers, switchboard panels and 11KV metering panels.

**2. RELATIONSHIP WITH THE PRINCIPAL TENDER DOCUMENT**

Save where expressly amended by the terms of this Addendum, the PTD shall continue to be in full force and effect. The provisions of this Addendum shall be deemed to have been incorporated in and shall be read and construed as part of the PTD.

**3. CLARIFICATIONS**


NO	Query	KPLC Response
	<b>Incoming CT Rating in Page 12</b>	
1	The incomer CT has 4 cores; we want to know what the tap configuration is?	The cores are well defined in page 12, table 2. Kindly adhere to the specifications
2	What does the accuracy Class X mean?	It means Knee point values are defined
3	We have two conflicting Ratio information: 600-1500/1/1/1/1A in page 12, while in page 20, it is	Provide 200-600-1200-1600/1-1-1-1A

NO	Query	KPLC Response
	mentioned 200-600-1200-1600/1-1-1-1A, pls let us know which one we shall follow?	
<b>Outgoing CT rating in page 12;</b>		
4	Also conflicting information Ratio: 200-400-600/1/1/1A in page 12, while in page 20, it is mentioned 200-300-600/1-1-1A, please let us know which one we shall follow.	Provide 200-400-600/1/1/1A
No.	Query	KPLC response
5	Having gone through the specifications, we have noted that they relate to both triple Pole operated and single pole operated circuit breakers which means some clauses are in conflict. For example, section 4.2.3 which requires the three poles to be interconnected with the operating mechanism while section 4.3.13 requires each pole to have separate operating mechanism.	Triple pole operated mechanism as per clause 4.2.3.

All other terms and conditions remain the same.

Yours faithfully,

**FOR: THE KENYA POWER & LIGHTING COMPANY LIMITED**

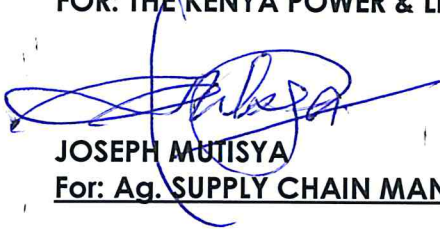

**JOSEPH MUTISYA**  
**For: Ag. SUPPLY CHAIN MANAGER, PROCUREMENT**