


CONNECTION DIAGRAM

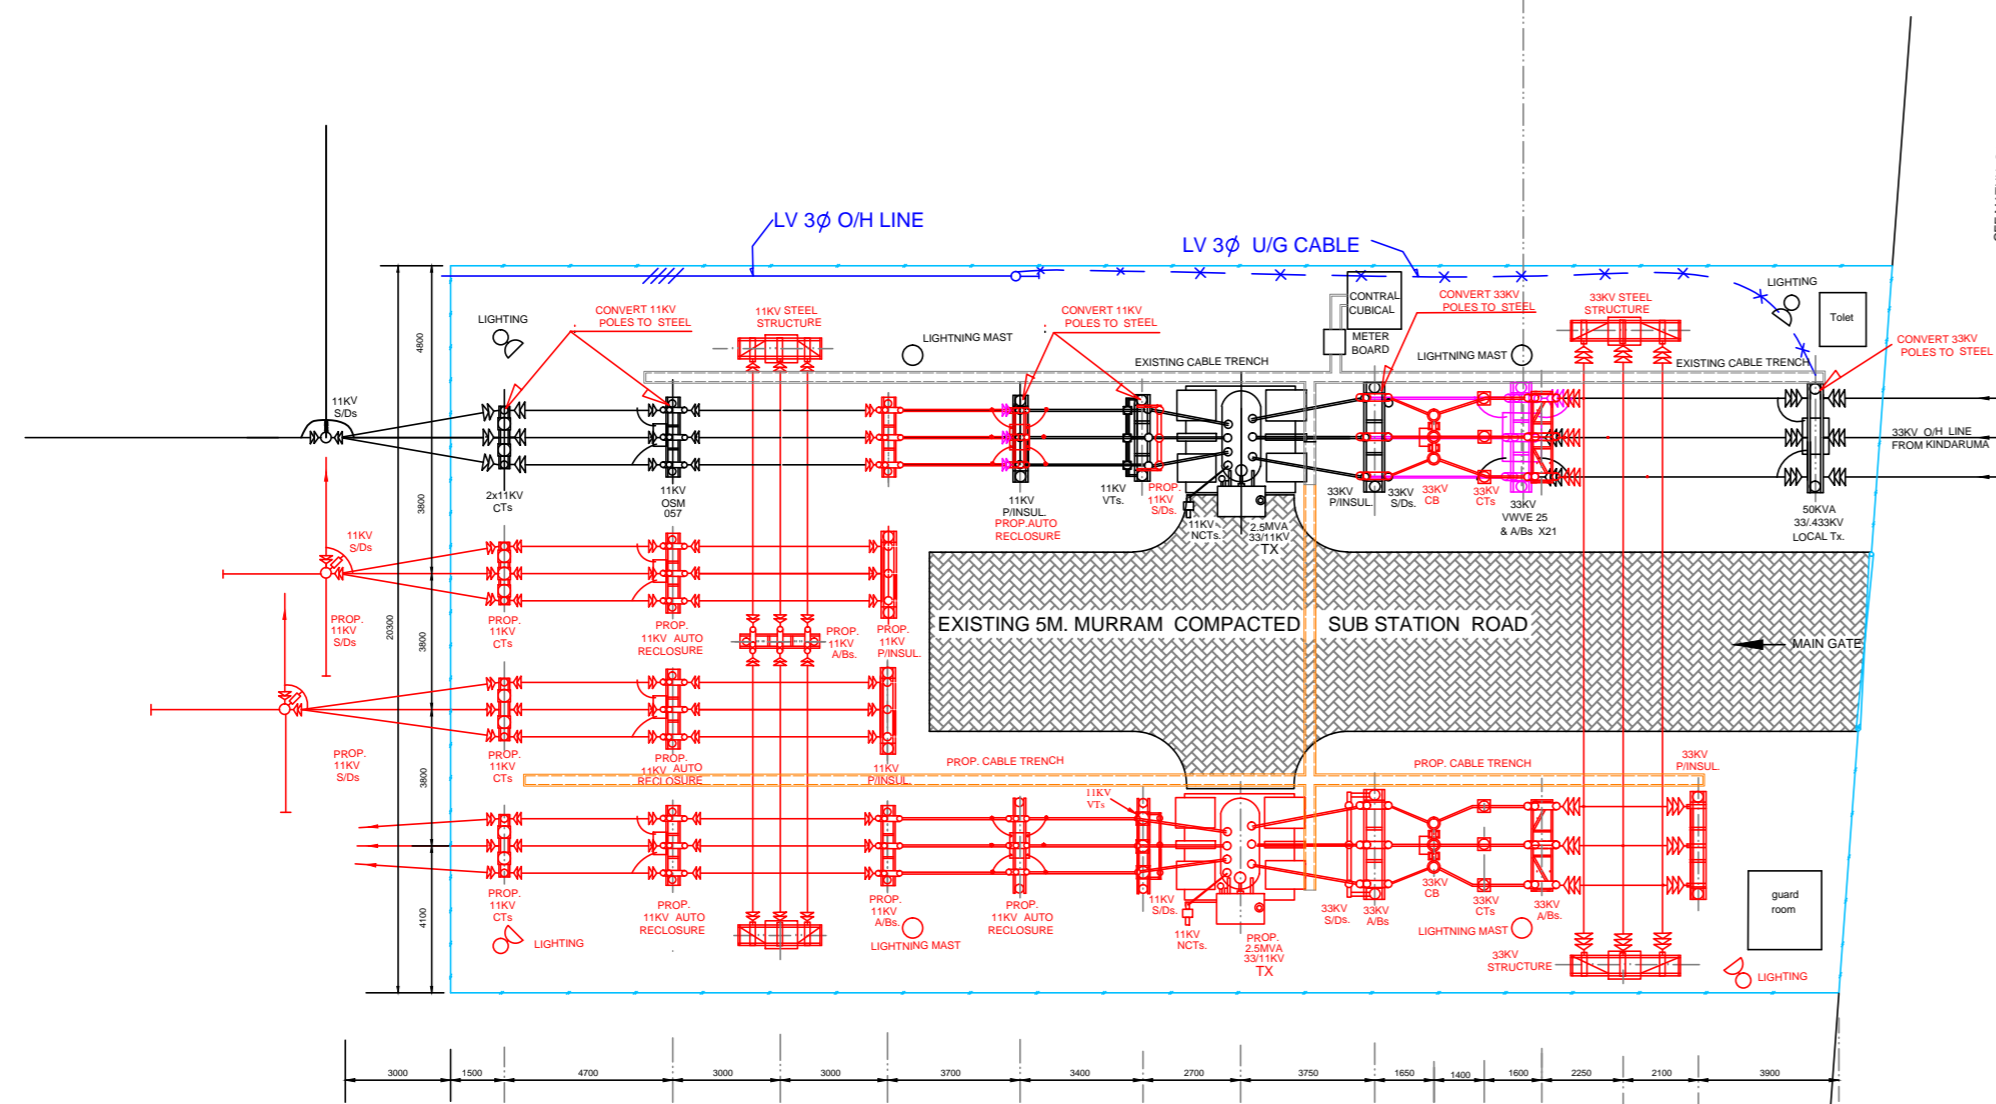

Key  
 EXISTING WORKS  
 PROPOSED WORKS  
 PROPOSED FENCE

	DATE	NAME	SIGN
APPROVED			
CHECKED ENGINEER LC		R. Kimani	
CHKD PRINCIPAL D/MAN		L. Oburo	
DRAWN	20-04-2016	S.M. Kimani	
TRACED			

PROPOSED REFURBISHMENT AND ADDITIONAL 2.5MVA OF MATUU 2.5MVA 33/11KV SUB- STATION.

SCALE 1:150

SHEET 1A

K.P. & L.Co LTD

SK No: 8055/A