



Kenya Power

Central Office - P.O. Box 30099 - 00100
Telephone – 254 – 02 - 3201000
Stima Plaza, Kolobot Road
Nairobi, Kenya
www.kenyapower.co.ke

Our Ref: KP1/9AA-3/OT/12/16-17/JO/em

Date. 1st September, 2016

M/s

Dear Sir/Madam,

ADDENDUM 1 TO THE TENDER NO. KP1/9AA-3/OT/61/16-17 FOR SUPPLY OF STEEL PREFABRICATED ITEMS FOR LOCAL MANUFACTURERS ONLY.

Please note that from the request of prospective bidders thereat and at our own initiative we make the following clarifications and amendments to the Principal Tender Document (*hereinafter abbreviated as PTD*) for Steel Prefabricated Items (Local Manufacturers Only).

1. RELATIONSHIP WITH THE PRINCIPAL TENDER DOCUMENT

Save where expressly amended by the terms of this Addendum, the Principal Tender Document shall continue to be in full force and effect.

The provisions of this Addendum shall be deemed to have been incorporated in and shall be read as part of the Principal Tender Document.

2. TENDER NUMBER

Tender Number KP1/9AA-3/OT/61/16-17.

Bidders are required to take note that the tender number has been amended to read KP1/9AA-3/OT/12/16-17

3. ITEM 3 CODE 186914 – CROSS STEEL TERMINAL

Bidders are required to take note that the correct drawing for the item is as per the copy of the attached Specification for Concrete Pole Items KPLC/3CB/TSP/03/011 marked as Appendix I

4. ITEM 6 CODE 186923 – STEEL CHANNEL U2290 x 100mm x 50mm

Bidders are required to take note that while the Tender Specification describe the item as **Transformer Platform up to 200MVA**, the item is the same. Bidders are requested to go by the tender document description of the item (**Steel Channel U2290x100mmx50mm**)

5. DEADLINE FOR SUBMISSION OF TENDER

The deadline for tender submission has been extended from Tuesday 6th September,2016 to **Wednesday 14th September, 2016**. All the other terms and conditions remain as per the tender document.

Yours faithfully,

For: KENYA POWER & LIGHTING COMPANY LIMITED.




JOYCE OCHIENG

Ag. SUPPLY CHAIN MANAGER, PROCUREMENT

APPENDIX I

Doc. No.	KPLC/13CB/ISP/03/011
Issue No.	1
Revision No.	1
Date of Issue	2009-08-01
Page 17 of 33	

TITLE:
SPECIFICATION FOR CONCRETE POLE FITTINGS

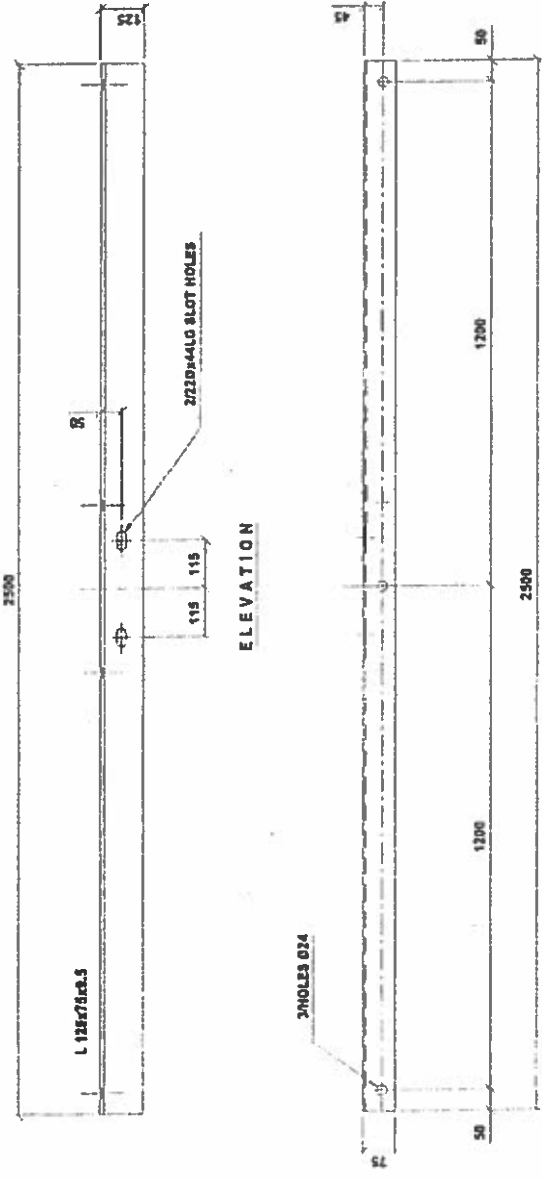

CODE 186914
FIG. 10: 33KV STEEL CROSSARM; TERMINAL (2500X125X75X9.5MM);

Issued by: Head of Section, Tech Stds & Specs	Authorized by: Head of Department R&D
Signed: <i>[Signature]</i>	Signed: <i>[Signature]</i>
Date: 2009-09-01	Date: 2009-09-01

