


SECTION Z-Z

SECTION Y-Y

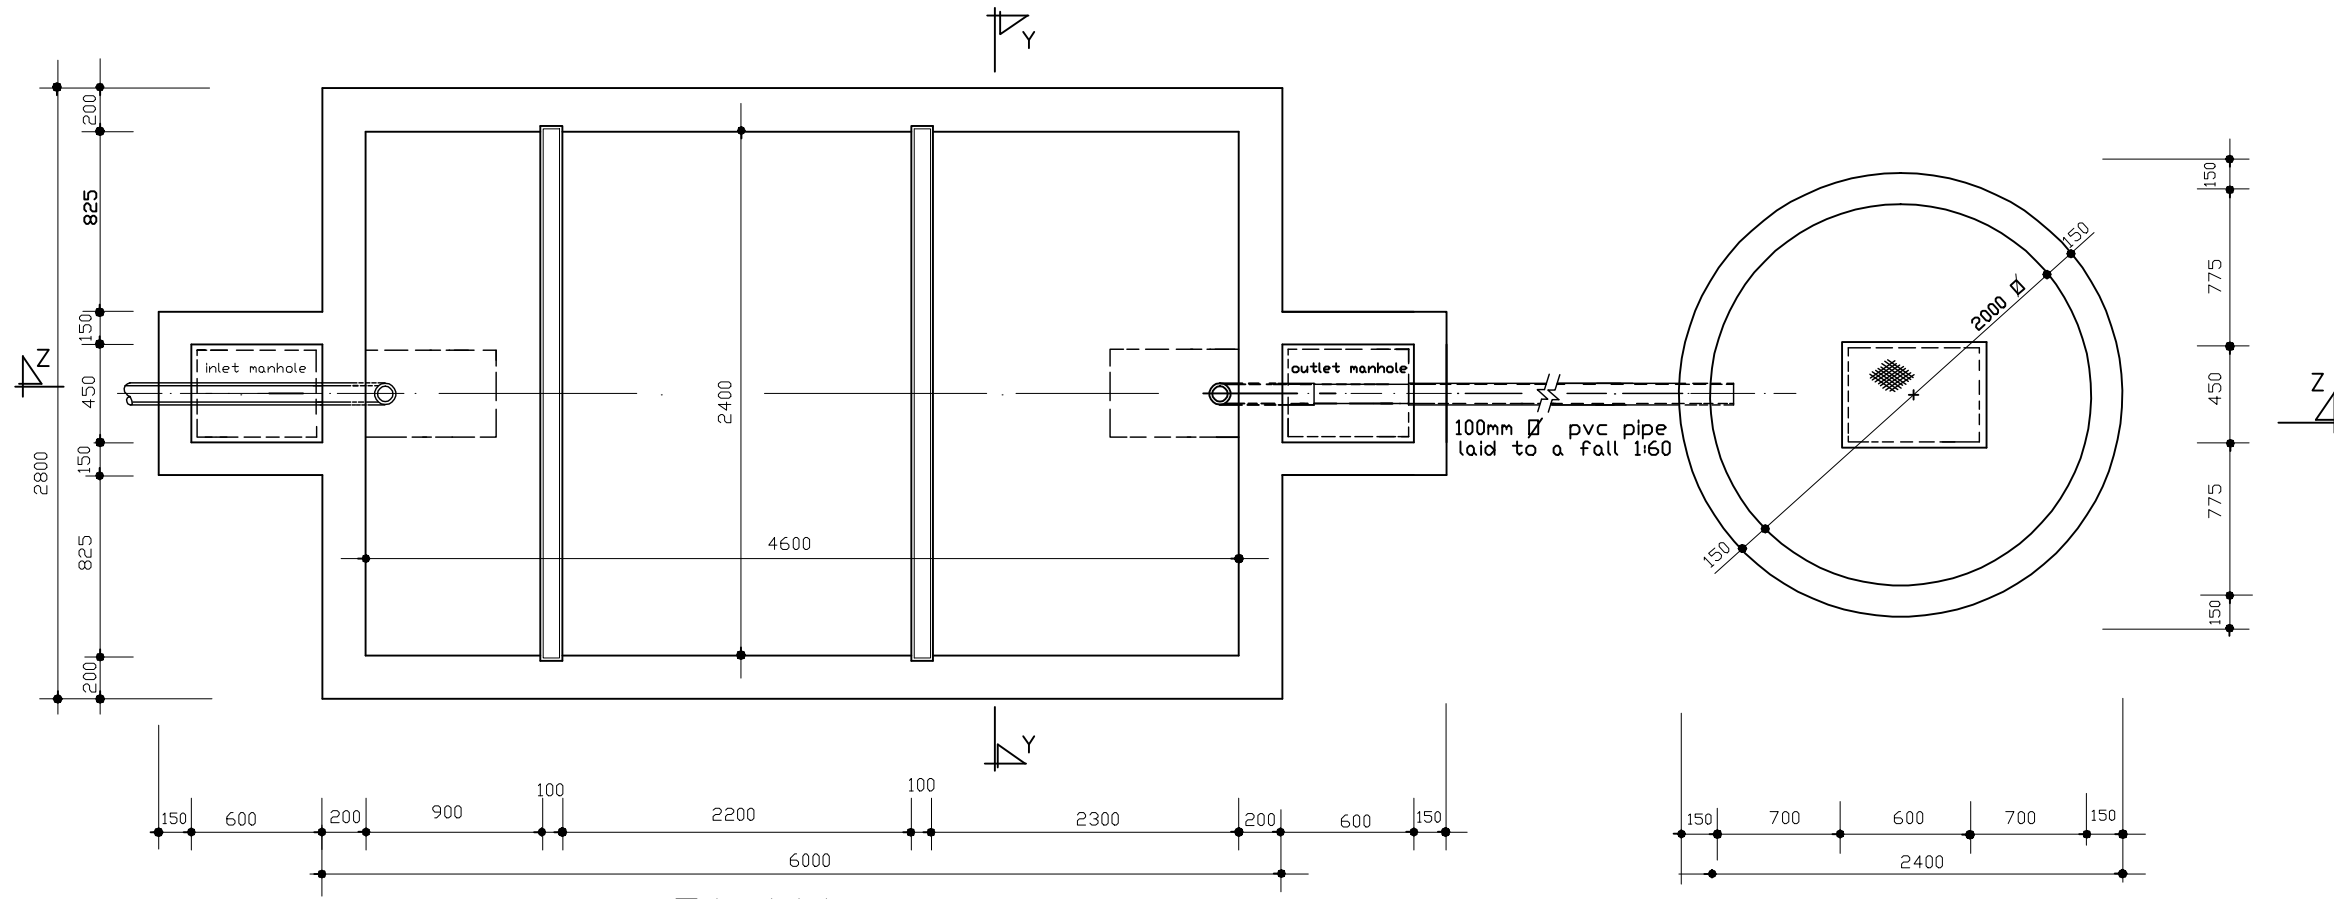

PLAN

NOTES

- 1 Cover slab to be reinforced with Y10 bars both ways conc. class 20(20)
- 2 Base slab to be conc. class mix 1:3:6
- 3 Outlet & inlet pipes to be 100 mm \square cast iron
- 4 Scum baffle to be 100mm thick reinforced with 2No.Y10 at both end conc. 20(20)
- 5 dividing wall to be to be 100mm thick reinforced with weld-mesh.

PROJECT			
PROPOSED SEPTIC TANK AND SOAK PIT			
CLIENT			
PLOT			
DESCRIPTION			
PLAN AND CROSS SECTIONS			
DRAWN	DATE	SCALE	DRG No.
J.M.Kahura	Sep. 2010		048