
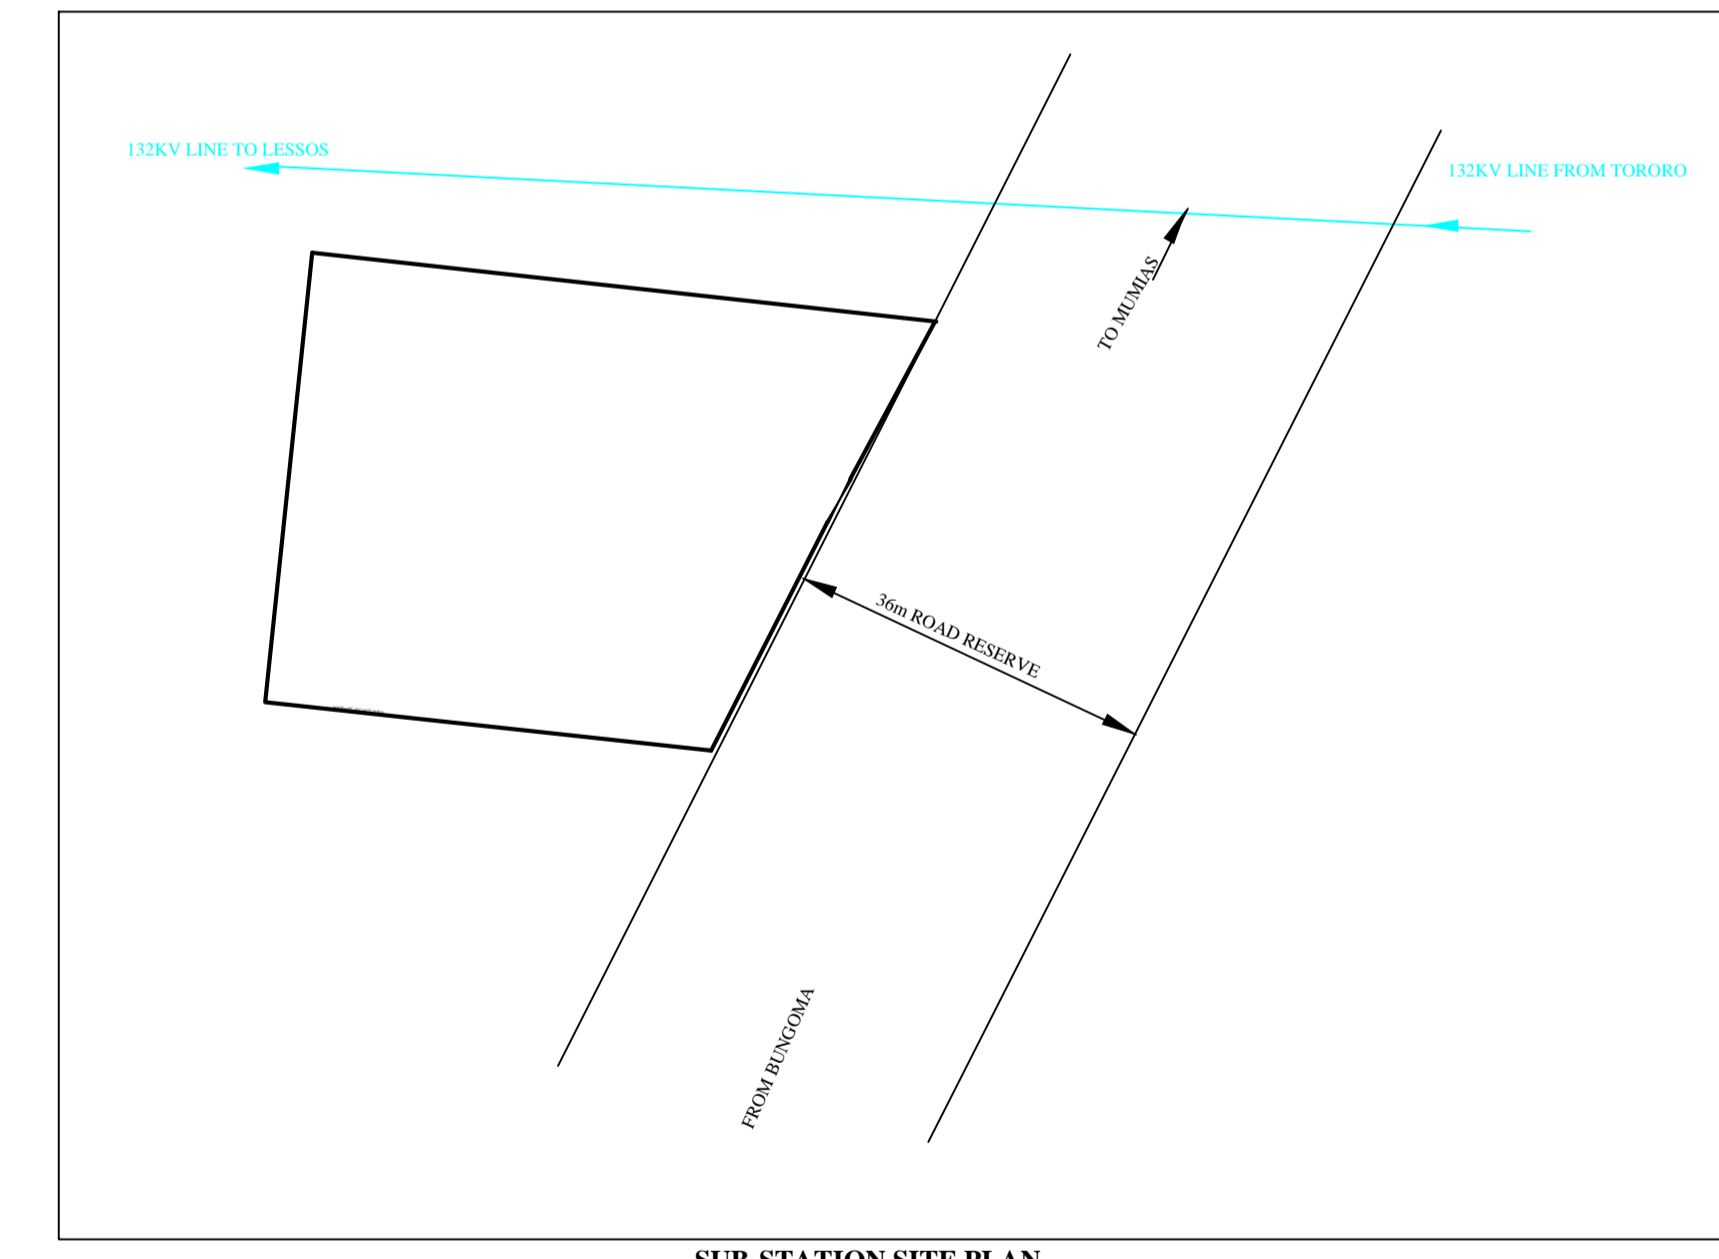


132KV LINE TO LESSOS ← 132KV LINE FROM TORORO

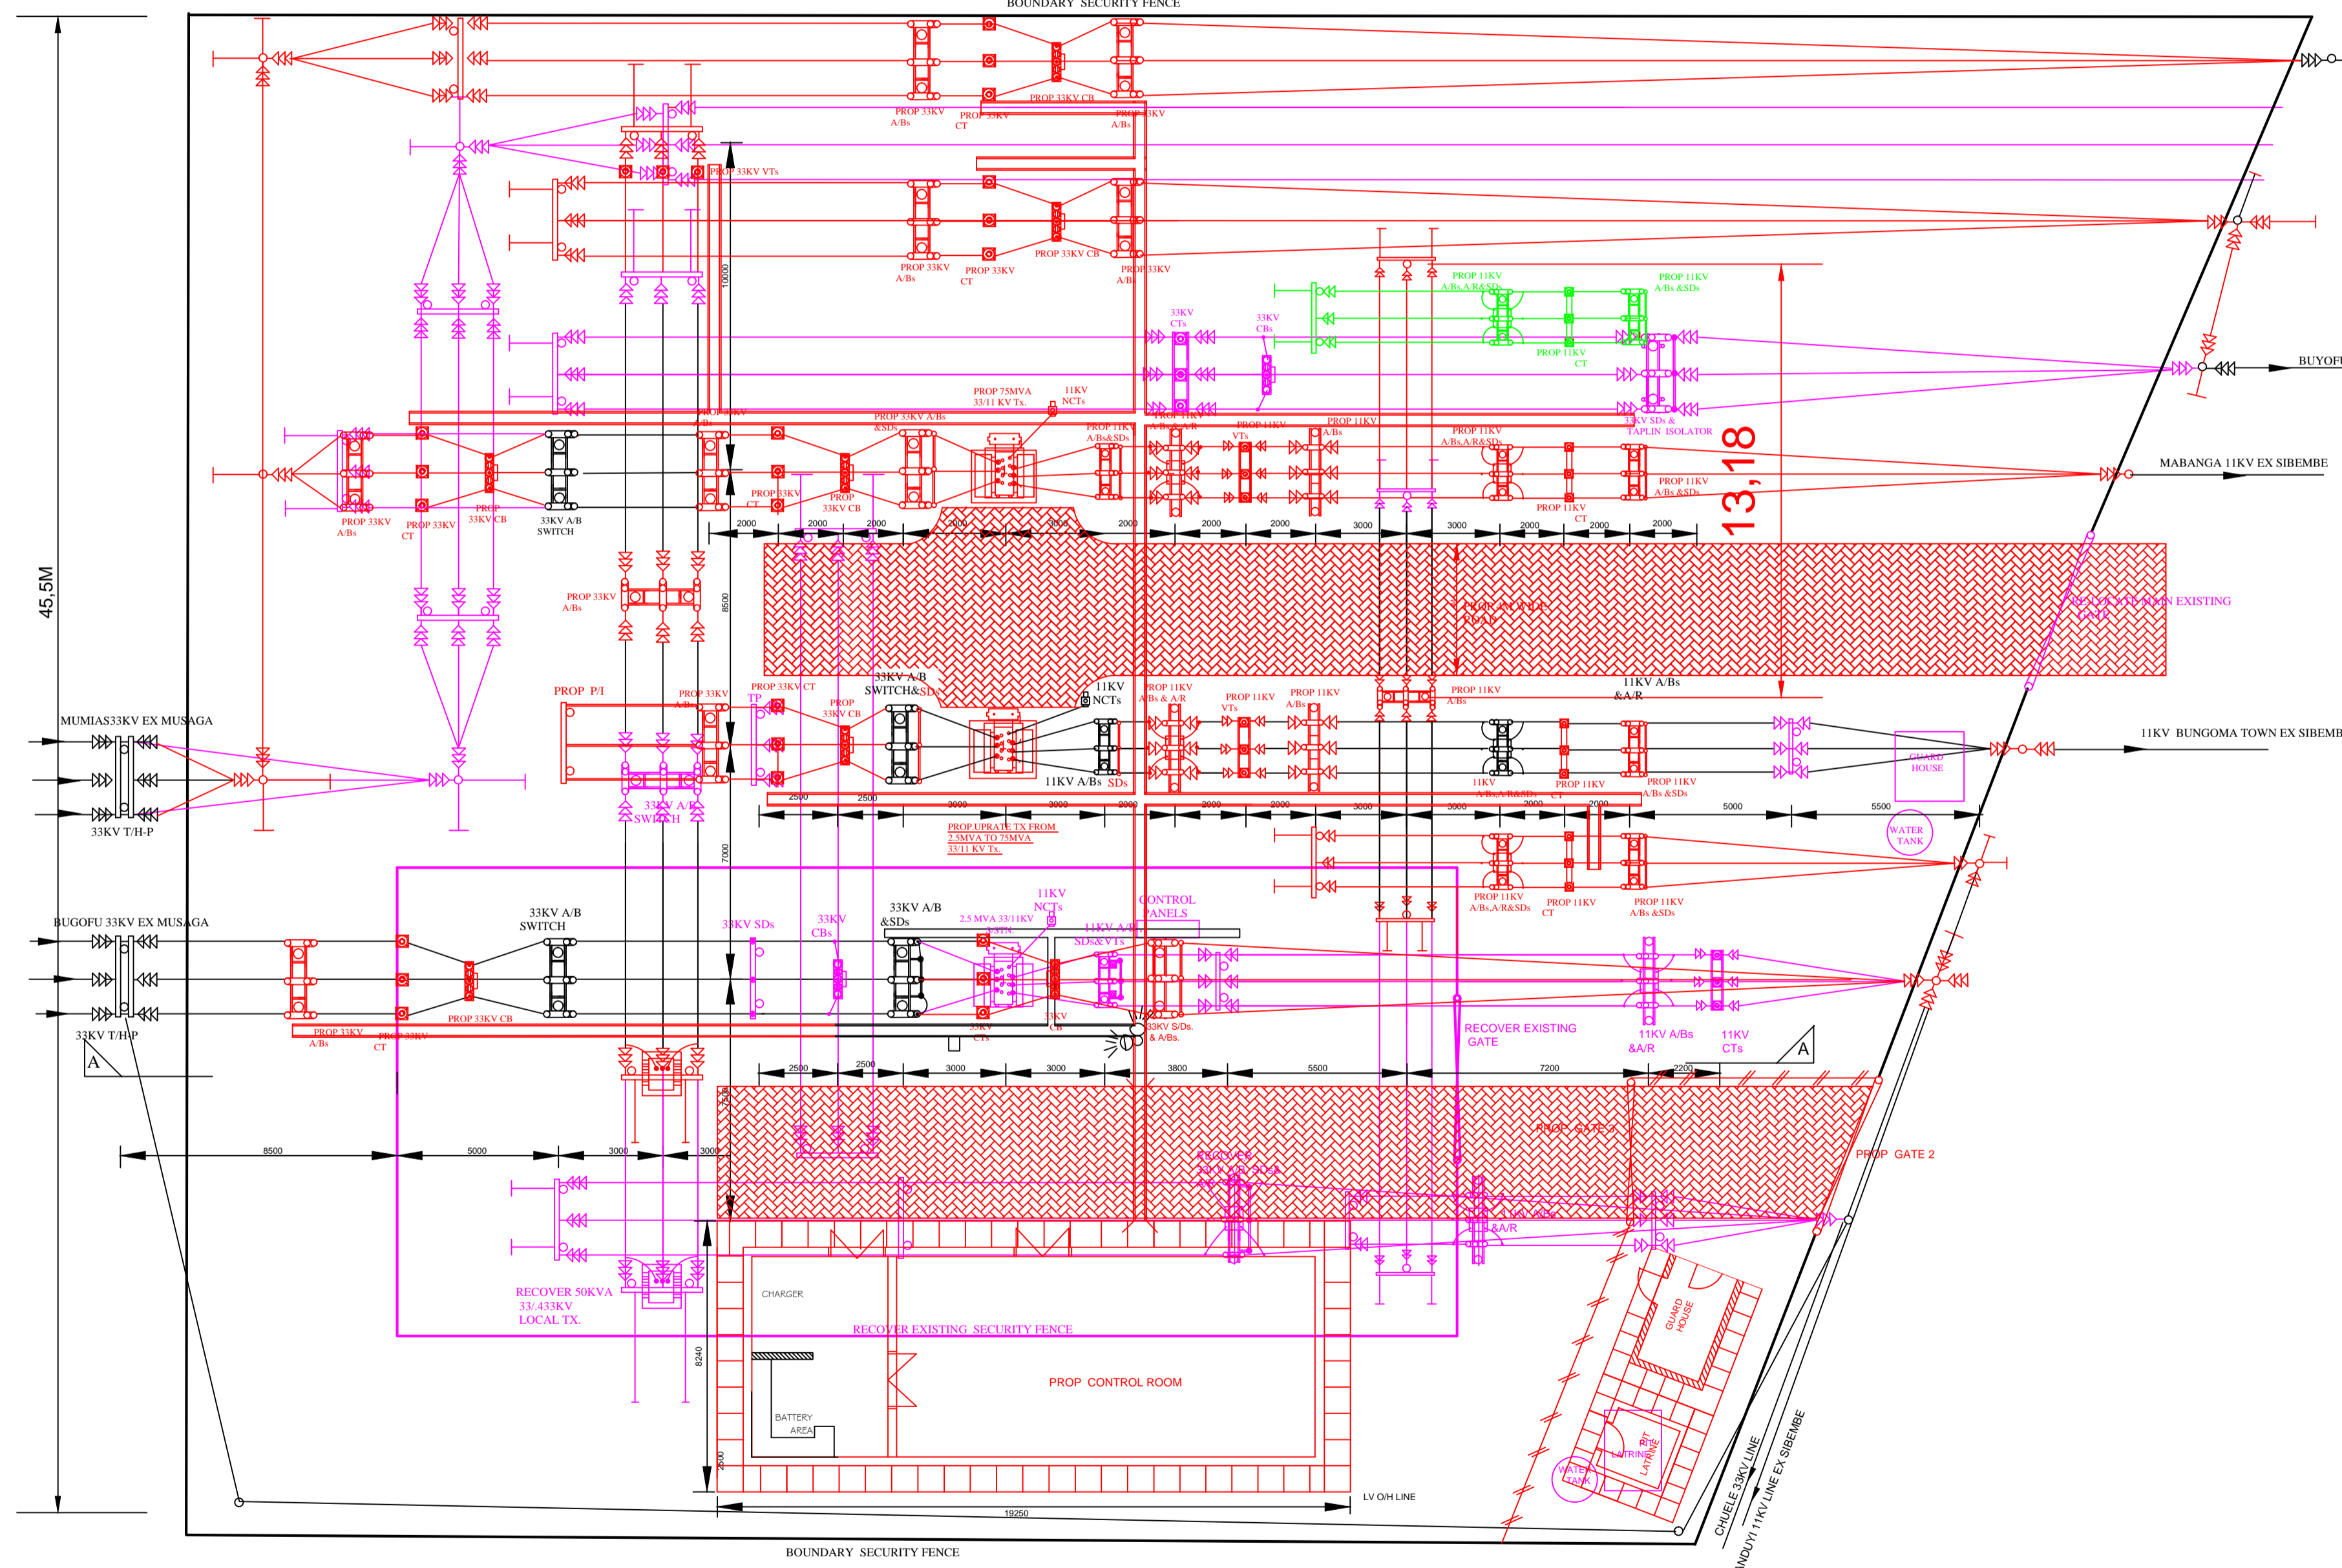

PROP SCHEMATIC DIAGRAM AFTER THE IMPLEMENTATION

SUB-STATION SITE PLAN SCALE 1:500

KEY	
EXISTING WORKS	—
PROP SPARE(11KV BAY)	—
PROPOSED WORKS	—
TO BE RE-LOCATED & RECOVERED /	—

NOTES
GENERAL ARRANGEMENT OF SIBEMBE 33/11KV S/STN.SEE SHEET No 07055/A

APPROVED	DATE	NAME	SIGN
CHECKED ENGINEER I/C		KAMAU	
CHECKED PRINCIPAL D/MAN		L.OBARO	
CHECKED SURVEYOR			
CHECKED PRINCIPAL SURVEYOR			
DRAWN	14/7/2014	JASPER	

REF.	REVISION
1	
2	
3	
4	
5	
6	

PROPOSED REFURBISHMENT OF 2x7.5MVA 33/11KV S/STN. SIBEMBE

SCALE 1:150

KENYA POWER

SK. No. 11208