



TITLE:

**SPECIFICATION FOR STEEL  
STRUCTURES FOR OVERHEAD  
LINES**

Doc. No. KP1/6C/13/TSP/03/003

Issue No. 2

Revision  
No. 0

Date of  
Issue 2015-08-10

Page 1 of 33

## TABLE OF CONTENTS

### 0.1 Circulation List



### 0.2 Amendment Record

## FOREWORD

1. SCOPE
2. REFERENCES
3. TERMS AND DEFINITIONS
4. REQUIREMENTS
5. TESTS AND INSPECTION
6. MARKING, LABELLING AND PACKING
7. DOCUMENTATIONS

**ANNEX A:** *Guaranteed Technical Particulars (to be filled and signed by the Manufacturer and submitted together with relevant copies of the Manufacturer's catalogues, brochures, drawings, technical data, sales records for previous five years, four customer reference letters, details of manufacturing capacity, the manufacturer's experience and copies of complete type test certificates and type test reports for tender evaluation, all in English Language)*

## ANNEX B: DRAWINGS

Issued by: Head of Section , Standards Development	Authorized by: Manager, Standards
Signed: 	Signed: 
Date: 2015-08-10	Date: 2015-08-10



**TITLE:**

**SPECIFICATION FOR STEEL  
STRUCTURES FOR OVERHEAD  
LINES**

<b>Doc. No.</b>	KP1/6C/13/TSP/03/003
<b>Issue No.</b>	2
<b>Revision No.</b>	0
<b>Date of Issue</b>	2015-08-10
Page 2 of 33	

**0.1 Circulation List**

<b>COPY NO.</b>	<b>COPY HOLDER</b>
1	Manager, Standards
Electronic copy (pdf) on Kenya Power server ( <a href="http://172.16.1.40/dms/browse.php?fFolderId=23">http://172.16.1.40/dms/browse.php?fFolderId=23</a> )	

**0.2 Amendment Record**

<b>Rev No.</b>	<b>Date (YYYY-MM-DD)</b>	<b>Description of Change</b>	<b>Prepared by (Name &amp; Signature)</b>	<b>Approved by (Name &amp; Signature)</b>
Issue 1 Rev 3	2008-04-09	Added requirement for Certificate of Compliance to ISO 1461 (clause 7) by the Hot Dip Galvanizer	Eng. S. Kimiti	G. Owuor
Issue 2 Rev 0	2015-08-20	Cancel and replaces KP1/3CB/TSP/03/003 Issue 1 Rev 3 dated 2008-04-09 and all previous issues	Michael Apudo 	Dr. Eng. Peter Kimemia

<b>Issued by: Head of Section , Standards Development</b>	<b>Authorized by: Manager, Standards</b>
<b>Signed:</b>	<b>Signed:</b>
<b>Date: 2015-08-10</b>	<b>Date: 2015-08-10</b>



**TITLE:**  
**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**

<b>Doc. No.</b>	KP1/6C/13/TSP/03/003
<b>Issue No.</b>	2
<b>Revision No.</b>	0
<b>Date of Issue</b>	2015-08-10
Page 3 of 33	

**FOREWORD**

This specification has been prepared by the Standards Department and the Drawing Office both of The Kenya Power & Lighting Company Limited (KPLC) and it lays down requirements for steel structures for overhead lines. It is intended for use by KPLC in purchasing the items.

The supplier shall submit information which confirms manufacturer's satisfactory service experience with products which fall within the scope of this specification.



**1. SCOPE**

- 1.1. This specification is for galvanized steel works for overhead lines and pole-mounted transformers.
- 1.2. This specification covers the following steelworks:
  - a) Steel cross arms of different configurations for use on power poles.
  - b) Supporting steelworks for distribution transformers, fuses, isolating links and other line equipment.
  - c) Steelworks for supporting and terminating HV and MV/LV overhead lines and services.
- 1.3. The specification stipulates the minimum requirements for the galvanized steel works for overhead lines in the company and it shall be the responsibility of the supplier to ensure adequacy of the design, good engineering practice, adherence to the specification and applicable standards and regulations as well as ensuring good workmanship in the manufacture of the items for The Kenya Power & Lighting Company.
- 1.4. This specification does not purport to include all the necessary provisions of a contract.

**2. REFERENCES**

The following standards contain provisions which, through reference in this text constitute provisions of this specification. Unless otherwise stated, the latest editions (including amendments) apply.

ISO 1461:                      Metallic Coatings – Hot dip galvanized coatings on fabricated ferrous products – Requirements.

<b>Issued by:</b> Head of Section , Standards Development	<b>Authorized by:</b> Manager, Standards
<b>Signed:</b> 	<b>Signed:</b> 
<b>Date:</b> 2015-08-10	<b>Date:</b> 2015-08-10



**TITLE:**

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**

<b>Doc. No.</b>	KP1/6C/13/TSP/03/003
<b>Issue No.</b>	2
<b>Revision No.</b>	0
<b>Date of Issue</b>	2015-08-10
Page 4 of 33	

- BS EN 1011 Part 1: Welding. Recommendations for welding of metallic materials. General guidance for arc welding
- BS EN 10056 – 1: Specification for structural steel equal and unequal angles. Dimensions
- BS EN 10 025: Hot rolled products of structural steel
- BS 6722: Recommendations for dimensions of metallic materials
- BS 4 Part 1: Structural steel sections. Specification for hot-rolled sections
- BS EN 20273: Fasteners. Clearance holes for bolts and screws
- BS 4-1:2005 Structural steel sections. Specification for hot-rolled section
- KS 02-572: Specification for hot-rolled structural steel sections
- ENA TS 43- 95: Steelwork for Overhead Lines

**3. TERMS AND DEFINITIONS**

For the purpose of this specification, the definitions in the reference standards shall apply.

**4. REQUIREMENTS**



**4.1. SERVICE CONDITIONS**

The steel structures shall be suitable for continuous use outdoors in tropical areas at altitudes of up to 2200m above sea level, humidity of up to 90%, average ambient temperature of +30°C with a minimum of -1°C and a maximum of +40°C and saline conditions along the coast.

**4.2. STEELWORKS**

4.2.1. The following general requirements shall apply to the range of steelwork required for the construction of overhead lines on wood, concrete & steel poles, attachments to buildings and tower lines. In general items shall comply with ENA TS 43- 95 issue 5 1989.

4.2.2. Unless otherwise specified the steel used in the manufacture of items to this specification shall conform to BS EN 10 025 Grade S.275JR and shall have the following properties:

<b>Issued by: Head of Section , Standards Development</b>	<b>Authorized by: Manager, Standards</b>
<b>Signed:</b> 	<b>Signed:</b> 
<b>Date: 2015-08-10</b>	<b>Date: 2015-08-10</b>



**TITLE:**

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**



<b>Doc. No.</b>	KP1/6C/13/TSP/03/003
<b>Issue No.</b>	2
<b>Revision No.</b>	0
<b>Date of Issue</b>	2015-08-10
Page 5 of 33	

- a) The tensile strength shall be 410 to 560MPa;
- b) The yield strength shall be 275MPa,
- c) Minimum percentage elongation after fracture ( $L_0 = 5.65 \sqrt{S_0}$ ) shall be 23% ;
- d) Impact strength of minimum energy shall be 27 J at a temperature of 20°C;
- e) Chemical composition of the ladle analysis for flat and long products of this steel grade shall be as per Table 1:

**Table 1: Ladle analysis**

Properties	Requirement
Designation	S.275JR
Method of de-oxidation	FN
C in % max. for nominal product thickness in mm	0.21
Si % max.	-
P % max.	1.50
S % max.	0.035
N % max.	0.035
Cu % max.	0.012
Other % max.	0.55
FN = rimming steels not permitted; FF = fully killed steel (see clause 6.2.2 of BS EN 10025-2).	

- 4.2.3. Equal and unequal angle sections shall conform to BS EN 10056 Part 1. Channel sections shall conform to BS 4, Part 1 and KS 02-572. Flat sections shall comply with BS 6722.
- 4.2.4. Bending of flat straps shall be carried out cold then stress-relieved at 600°C minimum or alternatively hot bent.
- 4.2.5. All ferrous materials shall be hot dip galvanized in accordance with ISO 1461 after fabrication and as per clause 4.3.6.
- 4.2.6. Welding shall be carried out in accordance with BS EN 1011 Part 1. After welding and before galvanizing, welds shall be thoroughly cleaned to remove slag and splatter, particular attention being paid to the toes of the welds and to the prevention of entrapment of slag and splatter. The preferred method of cleaning welds before galvanizing is by sandblasting.

<b>Issued by: Head of Section , Standards Development</b>	<b>Authorized by: Manager, Standards</b>
<b>Signed:</b> 	<b>Signed:</b> 
<b>Date: 2015-08-10</b>	<b>Date: 2015-08-10</b>



TITLE:

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**

Doc. No.	KP1/6C/13/TSP/03/003
Issue No.	2
Revision No.	0
Date of Issue	2015-08-10
Page 6 of 33	

- 4.2.7. Dimensions are subject to the following tolerances, unless otherwise stated: -
- a) Dimensions up to and including 10 mm - +1mm
  - b) Dimensions from 10 mm upto and including 50 mm - ±1 mm
  - c) Dimensions greater than 50 mm - ± 2 mm

4.2.8. Limiting dimensions of holes shall be within the tolerances or the 'medium fit series' of BS EN 20273, the hole diameters shown on the drawing correspond to the 'minimum diameter' column of the 'medium fit series'.

**4.3. CONSTRUCTION/FABRICATION**

4.3.1. All materials before and after fabrication shall be straight and free from twists. The material shall be free from blisters, scale and other defects.

4.3.2. Erection clearance for cleated ends of members connecting steel to steel shall not be greater than 2mm at each end.

4.3.3. The steel structures shall be assembled using bolts and nuts conforming to ISO 898-1 & 2. Bolt holes shall not be more than 2mm greater than the diameter of the bolt for bolts up to 24mm diameter and with tolerances as per clause 4.2.8.

4.3.4. Cutting may be by shearing, cropping, sawing or machine flare cutting. Sheared or cropped edge shall be dressed to a neat finish and be free from distortion where parts are to be in metal contact.

4.3.5. All holes shall be drilled in one operation and burrs shall be removed. Holes shall not be formed by a gas cutting process. All matching holes for bolts shall register with each other so that a gauge 2 mm less in diameter than the diameter of the bolt shall pass freely through the assembled members in a direction at right angle to such members.

**4.3.6. Galvanizing**

4.3.6.1. All materials to be galvanized shall be of the full dimensions shown or specified and all punching, cutting, and the removal of burrs shall be completed before the galvanizing process commences.

4.3.6.2. All galvanizing shall be done by the hot dip process (molten Zinc), not less than 98% of which must be pure Zinc. The process shall be in accordance with ISO 1461.

Issued by: Head of Section , Standards Development	Authorized by: Manager, Standards
Signed: 	Signed: 
Date: 2015-08-10	Date: 2015-08-10



**TITLE:**

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**

**Doc. No.** KP1/6C/13/TSP/03/003

**Issue No.** 2

**Revision No.** 0

**Date of Issue** 2015-08-10

Page 7 of 33

- 4.3.6.3. The zinc coating shall be uniform, clean, smooth and as free from spangle as possible.
- 4.3.6.4. Where specifically requested by KPLC, galvanized steel structures shall be treated after galvanizing with Sodium Dichromate Solution.

**Table 1: Zinc coating thickness**

	<b>Steel Structures for inland installations</b>	<b>Steel Structures for installation along the coast</b>
Minimum average coating thickness	85µm	110µm
Post-treatment (chromating)	See Tender Requirements	See Tender Requirements

**5. TESTS AND INSPECTION**

- 5.1. The steel structures for overhead lines shall be inspected and tested in accordance with the requirements of BS EN 10025-3:2004, ISO 1461:2009, BS EN 1011 Part 1, applicable Kenyan standards and all the provisions of this specification. It shall be the responsibility of the supplier to perform or to have performed the tests specified and whatever other tests he normally performs at works.
- 5.2. Copies of previous Type Tests Reports issued by a third party testing laboratory that is accredited to ISO/IEC 17025 shall be submitted with the tender for the purpose of technical evaluation. The accreditation certificate to ISO/IEC 17025 for the same third party testing laboratory used shall also be submitted with the tender document (all in English Language).  
The type tests shall include:
  - a) Steelwork shall be inspected and tested in accordance with BS EN 10025 – 3: 2004 Type S.275JR. The shall include:
    - (i) Classification and designation – clause 4.0
    - (ii) Manufacturing process – clause 6.0
    - (iii) General requirements – clause 7.1
    - (iv) Chemical composition – clause 7.2
    - (v) Mechanical properties – clause 7.3
    - (vi) Technological properties – clause 7.4
    - (vii) Surface properties – clause 7.5
    - (viii) Internal soundness – clause 7.6
    - (ix) Inspection – clause 8.0

<b>Issued by: Head of Section , Standards Development</b>	<b>Authorized by: Manager, Standards</b>
<b>Signed:</b>	<b>Signed:</b>
<b>Date: 2015-08-10</b>	<b>Date: 2015-08-10</b>



TITLE:

**SPECIFICATION FOR STEEL  
STRUCTURES FOR OVERHEAD  
LINES**

Doc. No.	KP1/6C/13/TSP/03/003
Issue No.	2
Revision No.	0
Date of Issue	2015-08-10
Page 8 of 33	

b) Tests on galvanizing shall be carried on the finished steel in accordance with the requirement of ISO 1461:2009 and this specification. Test reports shall be completed (by the manufacturer) and submitted to KPLC for approval before shipment/delivery of the materials. The test reports shall be submitted together with a Certificate of Compliance to ISO 1461 by the Hot Dip Galvanizer for every consignment. They shall include:

- (i) Sampling – clause 5.0
- (ii) Appearance – clause 6.1
- (iii) Thickness – clause 6.2
- (iv) Renovation – clause 6.3
- (v) Adhesion - clause 6.4
- (vi) Acceptance criteria – clause 6.5

c) Test on welds shall be done as per BS EN 1011-1:2009 and shall include fusion welding processes as per clause 7.0.

5.3. Routine and sample test reports for the steel structures for overhead lines to be supplied shall be submitted to KPLC for approval before shipment/delivery of the goods. KPLC Engineers will witness tests at the factory before shipment. Tests to be witnessed by KPLC Engineers at the factory before shipment shall include all the tests in clause 5.2 of this specifications.

5.4. On receipt of the steel structures, KPLC may perform any of the tests specified in order to verify compliance with this specification. The supplier shall replace without charge to KPLC steel structures which upon examination, test or use fail to meet any of the requirements in the specification.

**6. MARKING, LABELLING AND PACKING**

**6.1. Marking, labelling**

6.1.1. The products shall be legibly marked using methods such as stamping or laser marking with the following:

- a) The grade, the quality and if applicable the delivery condition (see EN 10025-2 and EN 10025-5) indicated by its abridged designation.
- b) A number by which the cast and if applicable the sample can be identified (if inspection is by cast);
- c) The manufacturer's name or trademark;

Issued by: Head of Section , Standards Development	Authorized by: Manager, Standards
Signed:	Signed:
Date: 2015-08-10	Date: 2015-08-10





**TITLE:**

**SPECIFICATION FOR STEEL  
STRUCTURES FOR OVERHEAD  
LINES**

<b>Doc. No.</b>	KP1/6C/13/TSP/03/003
<b>Issue No.</b>	2
<b>Revision No.</b>	0
<b>Date of Issue</b>	2015-08-10
Page 9 of 33	

d) The mark of the external inspection representative (where applicable).

**NOTE:** This depends on the type of inspection document (see clause 8.2 of BS EN 10025-1).

6.1.2. Marking shall be at a position close to one end of each product or on the end cut face at the manufacturer's discretion, but shall be so positioned as to avoid confusion with regulatory marking. Where regulatory marking also meets the requirements for this clause, this Clause will be deemed to have been satisfied without repetition of the information provided with the regulatory marking.

**6.2. Packaging**

6.2.1. The supplier shall ensure that each item is suitably packaged ensuring it is "fit for service" prior to installation taking account of the potential for an outdoor storage environment. All packaging shall be sufficiently durable giving regard to the function, reasonable use and contents of the packaging. Where steelwork sets are required they shall be supplied securely packaged together.



6.2.2. Palletised goods shall be supplied on standard 1200mm x 1000mm pallets.

6.2.3. Clearly legible, easily identifiable, durable and unambiguous labelling shall be applied to each individual and where relevant multiple package of like products. Where product packages tendered are made up of sub packages, each sub package shall be marked. As a minimum requirement the following shall be included.

- a) Manufacturer's trademark or name
- b) Supplier's trademark or name
- c) Description of item
- d) Date of packaging and/or batch number
- e) KPLC product code
- f) Weight

6.2.4. Each assembly and package of items associated with this specification shall be suitably marked with reference to KPLC Stores Code.

6.2.5. Where an item includes a number of components to form a complete assembly, all component parts shall be included in one composite package which shall be firmly strapped or bound together.

<b>Issued by: Head of Section , Standards Development</b>	<b>Authorized by: Manager, Standards</b>
<b>Signed:</b> 	<b>Signed:</b> 
<b>Date: 2015-08-10</b>	<b>Date: 2015-08-10</b>



TITLE:

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**

Doc. No.	KP1/6C/13/TSP/03/003
Issue No.	2
Revision No.	0
Date of Issue	2015-08-10
Page 10 of 33	

**7.0. DOCUMENTATION**



7.1. The bidder shall submit its tender complete with technical documents required by Annex A (Guaranteed Technical Particulars) for tender evaluation. The technical documents to be submitted (all in English language) for tender evaluation shall include the following:

- a) Guaranteed Technical Particulars fully filled and signed by the manufacturer;
- b) Copies of the Manufacturer's catalogues, brochures, drawings and technical data of each steel structure on tender;
- c) Sales records and customer reference letters;
- d) Details of manufacturing capacity and the manufacturer's experience;
- e) Copies of required type test reports by a third party testing laboratory accredited to ISO/IEC 17025;
- f) Copy of accreditation certificate to ISO/IEC 17025 for the testing laboratory.
- g) Manufacturer's warranty and guarantee
- h) Manufacturer's letter of authorization, copy of the manufacturer's ISO 9001:2008/ KEBS Diamond mark certificate and other technical documents required in the tender.

7.2 The successful bidder (supplier) shall submit the following documents/details to The Kenya Power & Lighting Company for approval before manufacture:

- a) Guaranteed Technical Particulars signed by the manufacturer;
- b) Design Drawings with details of each steel structure to be manufactured for KPLC.
- c) Quality assurance plan (QAP) that will be used to ensure that the design, material; workmanship, tests, service capability, maintenance and documentation will fulfil the requirements stated in the contract documents, standards, specifications and regulations. The QAP shall be based on and include relevant parts to fulfil the requirements of ISO 9001:2008
- d) Detailed test program to be used during factory testing;
- e) Marking details and method to be used in marking the each steel structure;
- f) Manufacturer's undertaking to ensure adequacy of the design, good engineering practice, adherence to the specification and applicable standards and regulations as well as ensuring good workmanship in the manufacture of the steel structures for The Kenya Power & Lighting Company;
- g) Packaging details (including packaging materials).

7.3 The supplier shall submit recommendations for use, care, storage and routine inspection/testing procedures, all in the English Language, during delivery of the each steel structure to KPLC store

Issued by: Head of Section , Standards Development	Authorized by: Manager, Standards
Signed: 	Signed: 
Date: 2015-08-10	Date: 2015-08-10



**Kenya Power**

**TITLE:**

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**

**Doc. No. KP1/6C/13/TSP/03/003**

**Issue No. 2**

**Revision No. 0**

**Date of Issue 2015-08-10**



Page 11 of 33

**ANNEX A: Guaranteed Technical Particulars** (to be filled and signed by the Manufacturer and submitted together with relevant copies of the Manufacturer's catalogues, brochures, drawings, technical data & calculations, sales records for past five years, four customer reference letters, details of manufacturing capacity, the manufacturer's experience, copies of complete type test reports and accreditation certificate to ISO/IEC 17025 for the third party testing laboratory for tender evaluation, all in English Language).

**BIDDERS NAME & ADDRESS** .....

**TENDER NO.** .....

Description		Bidders offer	
Name of Manufacturer & Country of manufacture of the		State	
Type/Model Reference Number		State	
1.	Scope		
	Type and Size		
	Steel cross arms of different configurations for use on power poles	State	
	Supporting steelworks for distribution transformers, fuses, isolating links and other line equipment.	State	
	Steelworks for supporting and terminating HV and MV/LV overhead lines and services.	State	
2.	Standards of manufacture	State	
3.	Terms and definitions	State	
4.	Requirements	State	
4.1	Service Conditions	State	
4.3	Steel works	Items shall be as per ENA TS 43- 95, Issue 5	
		Physical characteristics	Grade of steel
			Standard of manufacture
			Tensile strength, MPa
			Yield Strength, MPa
			Min, % elongation after fracture( $L_0=5.65 \cdot S^{1/2}$ )
		Chemical composition of steel	Impact strength (J)
			Designation
			Method of de-oxidation
			C in % max. for nominal product thickness in mm
Si % max.			
		State the offered values as per the test reports, catalogues, brochures, and or drawings for each item offered.	

Issued by: Head of Section , Standards Development	Authorized by: Manager, Standards
Signed: 	Signed: 
Date: 2015-08-10	Date: 2015-08-10



**TITLE:**

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**

**Doc. No.**

**KP1/6C/13/TSP/03/003**

**Issue No.**

**2**

**Revision No.**

**0**

**Date of Issue**

**2015-08-10**

Page 12 of 33

		P % max.		
		S % max.		
		N % max.		
		Cu % max.		
		Other % max.		
	Standard of manufacture of other materials	Equal and unequal angle sections		
		Channel sections		
		Flat sections		
	Bending of flat sections	Method		
		Temperature		
	Welding	Standard		
		Type		
		Method		
	Dimension tolerances	Up to and including 50mm		
		Greater than 50mm		
	Construction	Finish		
		Erection clearance for cleated ends		
		Bolt tolerances		
		Cutting method		
		Holes	Method of drilling and cutting Tolerances	
	Galvanizing	Standard it conforms to		
		Process		
		Purity of zinc used		
		Coating thickness	Inland Coastal	
		Treatment after galvanizing		
			State	
4.5	Quality Management System		State	
	Quality Assurance Plan		State	
	Copy of ISO 9001:2008 Certificate		State	
	Manufacturer's experience		State	
	Manufacturing Capacity (units per month)		State	
	List of previous customers		State	
	Customer reference letters		State	
5.1	Test standards and responsibility of carrying out tests		provide	
5.2	Copies of Type Test Reports submitted with tender		provide	

**Issued by: Head of Section , Standards Development**

**Authorized by: Manager, Standards**

**Signed:**

**Signed:**

**Date: 2015-08-10**

**Date: 2015-08-10**



Kenya Power

TITLE:

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**

Doc. No. KP1/6C/13/TSP/03/003

Issue No. 2

Revision No. 0

Date of Issue 2015-08-10

Page 13 of 33

5.3	Acceptance tests to be witnessed by KPLC at factory before shipment	provide
5.4	Test reports to be submitted by supplier to KPLC for approval before shipment	provide
5.5	Replacement of rejected steel structures	provide
6.1	Marking	provide
6.2	<b>Packing</b>	provide
7.1	Documents submitted with tender	provide
7.2	Documents to be submitted by supplier to KPLC for approval before manufacture	provide
8.0	Manufacturer's Guarantee and Warranty	provide
9.0	List catalogues, brochures, technical data and drawings submitted to support the offer	provide
10.0	List customer sales records and reference letters submitted to support the offer	provide
11.0	List Test Certificates submitted with tender	provide
12.0	List test reports of the surge arresters to be submitted to KPLC for approval before shipment	provide
13.0	Statement of compliance to specification (indicate deviations if any & supporting documents)	provide

**NOTE:**

- 1) Bidders shall give full details of the offered values for the items on order as per Annex A. The details provided shall conform to the test reports and their certificates as required by clause 5.2., well labeled drawings complete with dimensions, catalogues and/or brochures for the purpose of tender evaluation. Bidders who shall have not complied by this requirement shall be automatically disqualified from bidding this item.*
- 2) The schedule in Annex A does not in any way substitute for detailed information required elsewhere in the specification.*

.....  
**Manufacturer's Name, Signature, Stamp and Date**

Issued by: Head of Section , Standards Development

Authorized by: Manager, Standards

Signed:

Signed:

Date: 2015-08-10

Date: 2015-08-10

TITLE:

**SPECIFICATION FOR STEEL  
STRUCTURES FOR OVERHEAD  
LINES**

Doc. No. KP1/6C/13/TSP/03/003


Issue No. 2

Revision No. 0

Date of Issue 2015-08-10

Page 14 of 33

**ANNEX B: DRAWINGS AS PER ENATS 43- 95 Issue 5 1989**

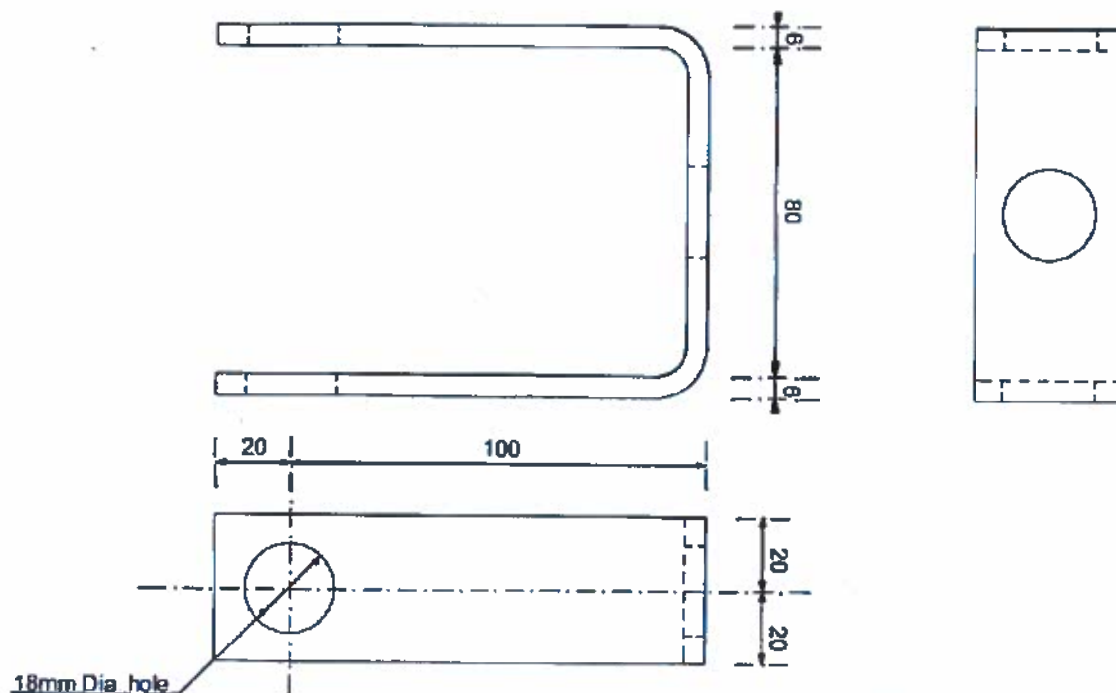

**FIG. 1: D – IRON (LV Insulator Bracket): KPLC CODE 181201 (332mm x 40mm x 6mm structural steel, galvanized)**

Issued by: Head of Section , Standards Development

Authorized by: Manager, Standards

Signed:



Signed:



Date: 2015-08-10

Date: 2015-08-10

**TITLE:**

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**


**Doc. No.** KP1/6C/13/TSP/03/003

**Issue No.** 2

**Revision No.** 0

**Date of Issue** 2015-08-10

Page 15 of 33

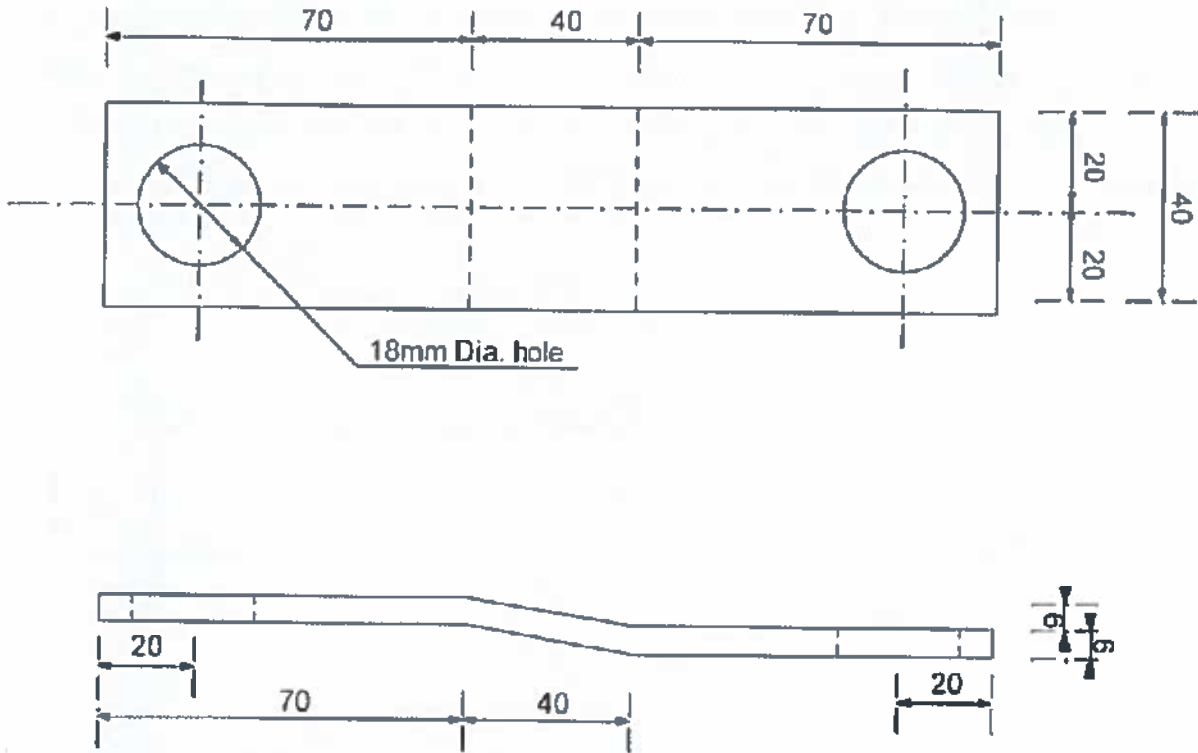

**FIG. 2: SHACKLE STRAP (LV Extension Strap): KPLC CODE 188104 (180mm x 40mm x 6mm structural steel, galvanized)**

**Issued by: Head of Section , Standards Development**

**Authorized by: Manager, Standards**

**Signed:**



**Signed:**



**Date: 2015-08-10**

**Date: 2015-08-10**

TITLE:

**SPECIFICATION FOR STEEL  
STRUCTURES FOR OVERHEAD  
LINES**


Doc. No. KP1/6C/13/TSP/03/003

Issue No. 2

Revision No. 0

Date of Issue 2015-08-10

Page 16 of 33

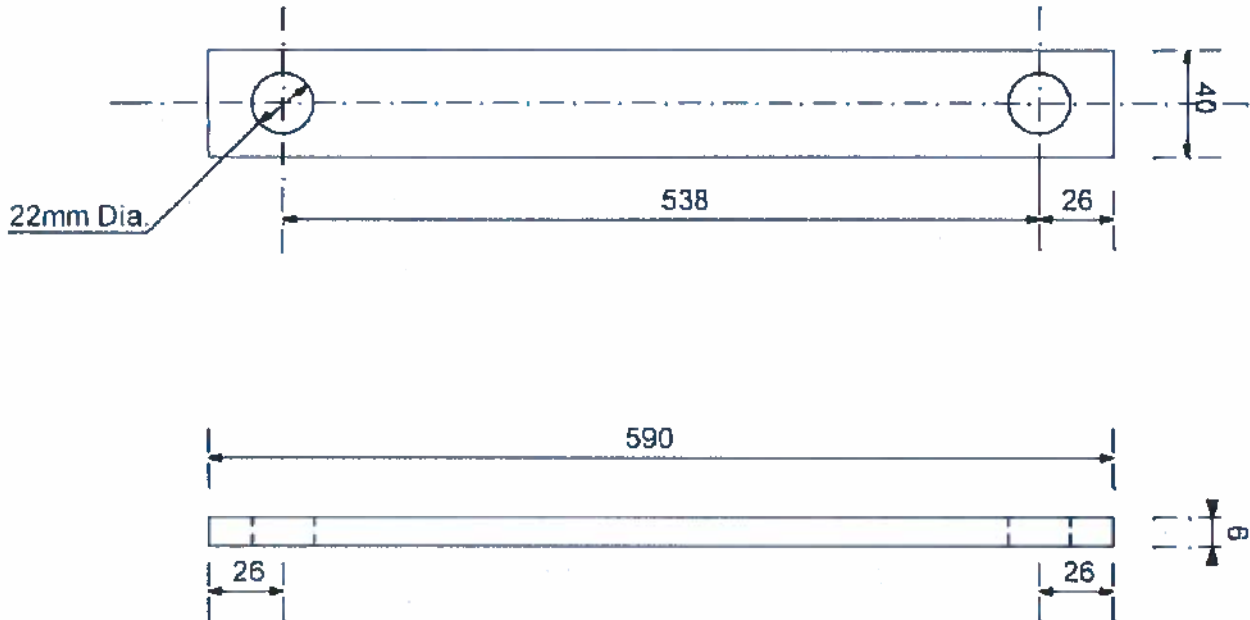

**FIG. 3A: 11KV FLAT TIE STRAP: KPLC CODE 188115 (590mm x 40mm x 6mm structural steel, galvanized)**

Issued by: Head of Section , Standards Development

Authorized by: Manager, Standards

Signed:




Signed:



Date: 2015-08-10



Date: 2015-08-10

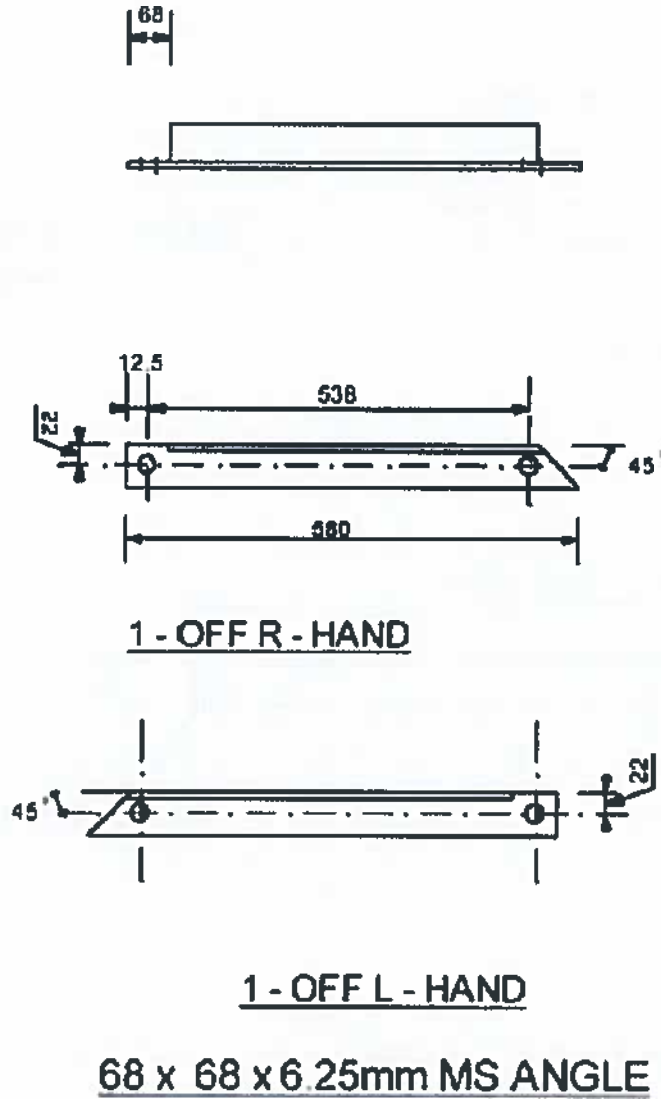




**FIG. 3B: 11KV ANGLE TIE STRAP: KPLC CODE 188111** (580mm x 68mm x 68mm x 6.25mm structural steel angle, galvanized)

**NOTE: To be supplied in pairs, application similar to that shown in Fig. 17.**

Issued by: Head of Section , Standards Development	Authorized by: Manager, Standards
Signed: 	Signed: 
Date: 2015-08-10	Date: 2015-08-10

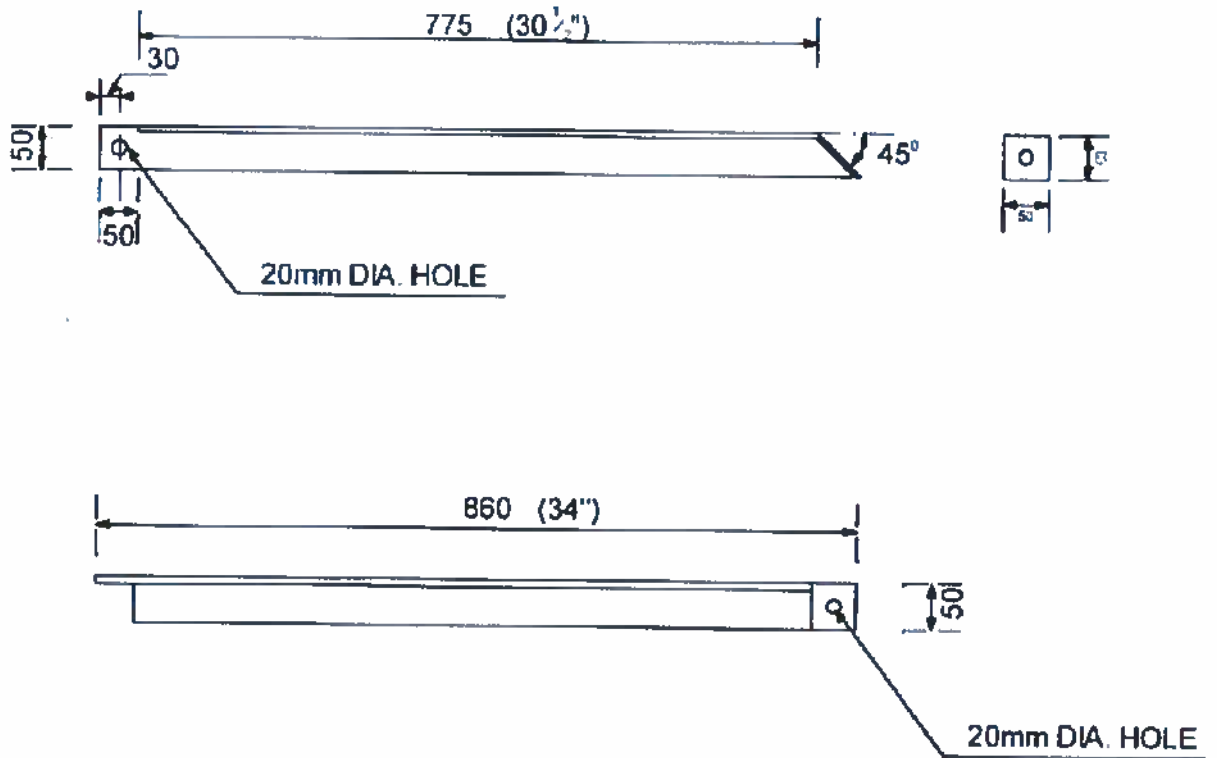

**FIG. 4: 33KV TIE STRAP: KPLC CODE 188108** (860mm x 50mm x 50mm x 6mm structural steel angle, galvanized)  
**The item to be supplied in pairs (see Fig. 16 showing application of the item).**

Issued by: Head of Section , Standards Development

Authorized by: Manager, Standards

Signed:




Signed:






Date: 2015-08-10

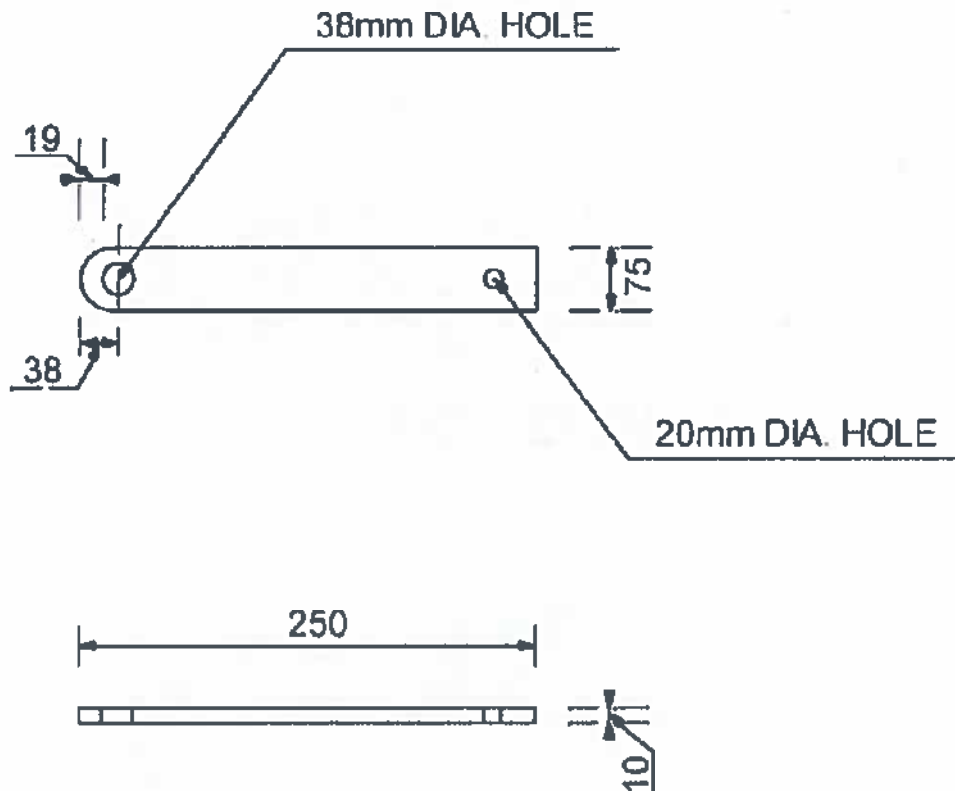Date: 2015-08-10



**FIG. 5: 11KV TERMINAL STRAP: KPLC CODE 188107 (250mm x 75mm x 10mm structural steel flat, galvanized)**

Issued by: Head of Section , Standards Development	Authorized by: Manager, Standards
Signed: 	Signed: 
Date: 2015-08-10	Date: 2015-08-10

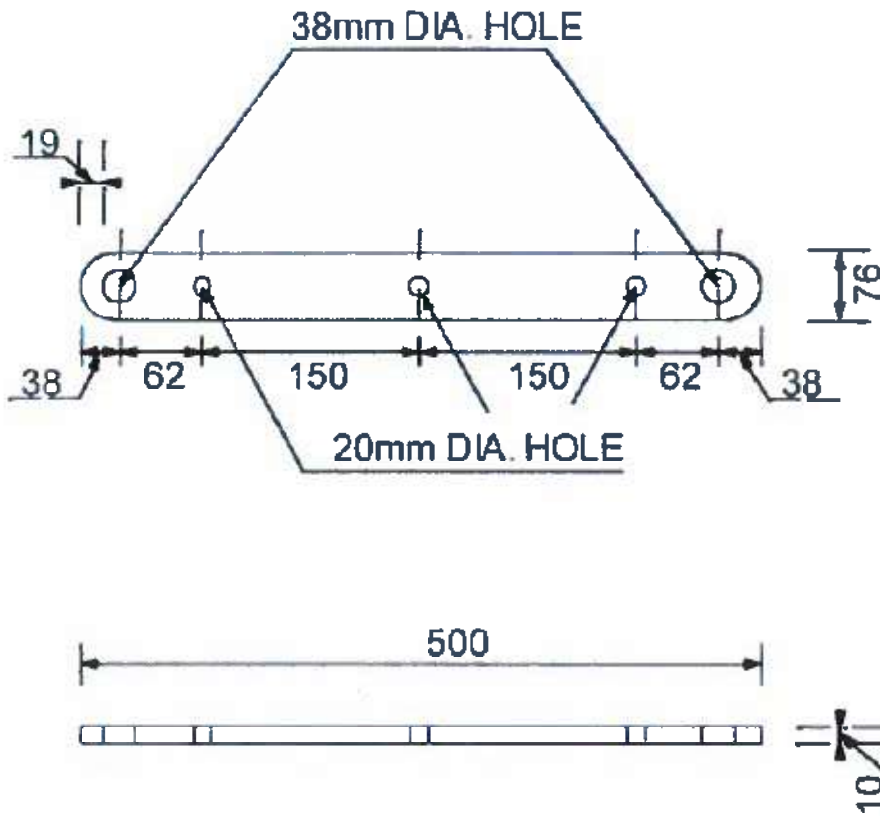

**FIG. 6: 33kV TERMINAL STRAP: KPLC CODE 188109 (500mm x 76mm x 10mm structural steel flat, galvanized)**

Issued by: Head of Section , Standards Development

Authorized by: Manager, Standards

Signed:



Signed:



Date: 2015-08-10

Date: 2015-08-10



TITLE:

**SPECIFICATION FOR STEEL  
STRUCTURES FOR OVERHEAD  
LINES**


Doc. No. KP1/6C/13/TSP/03/003

Issue No. 2

Revision No. 0

Date of Issue 2015-08-10

Page 21 of 33

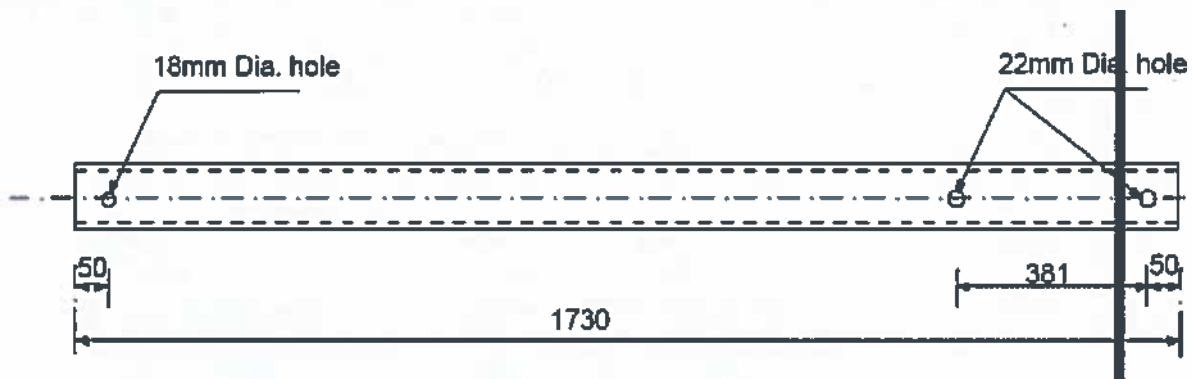

**FIG. 7: EARTH STOCK: KPLC CODE 186928** ('U' Channel 1730mm x 100mm x 50mm x 6mm structural steel, galvanization.

Issued by: Head of Section , Standards Development


Authorized by: Manager, Standards

Signed:



Signed:

Date: 2015-08-10

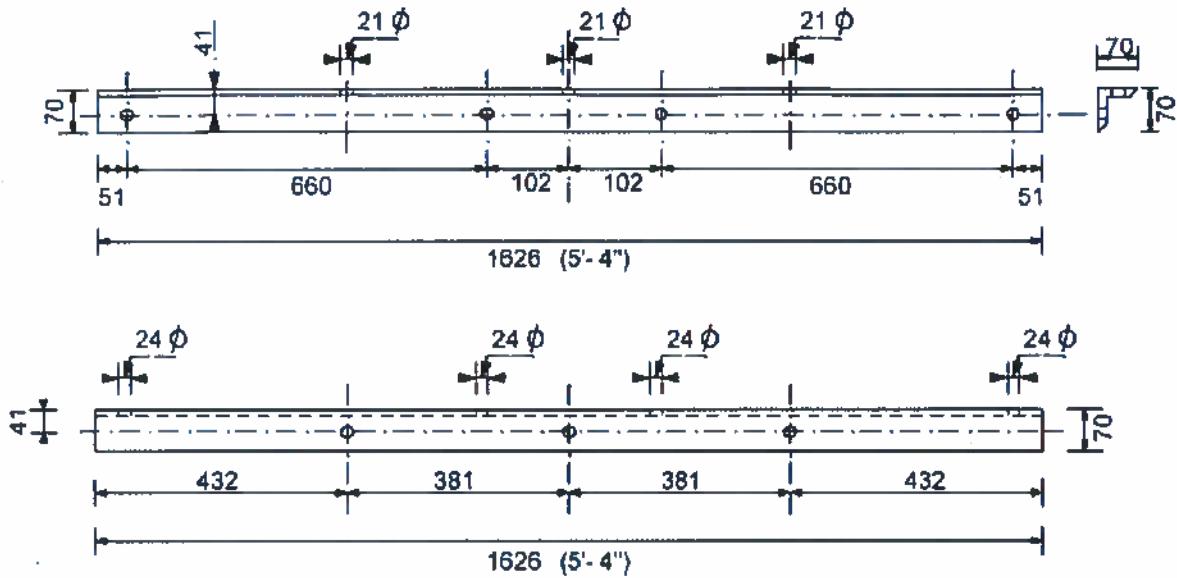Date: 2015-08-10



**FIG. 8A: 11KV CROSS ARM: KPLC CODE 182911 (L1625mm x 70mm x 70mm x 9.5mm structural steel angle, galvanized)**

Issued by: Head of Section , Standards Development	Authorized by: Manager, Standards
Signed: 	Signed: 
Date: 2015-08-10	Date: 2015-08-10

**TITLE:**

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**


**Doc. No.** KP1/6C/13/TSP/03/003

**Issue No.** 2

**Revision No.** 0

**Date of Issue** 2015-08-10

Page 23 of 33

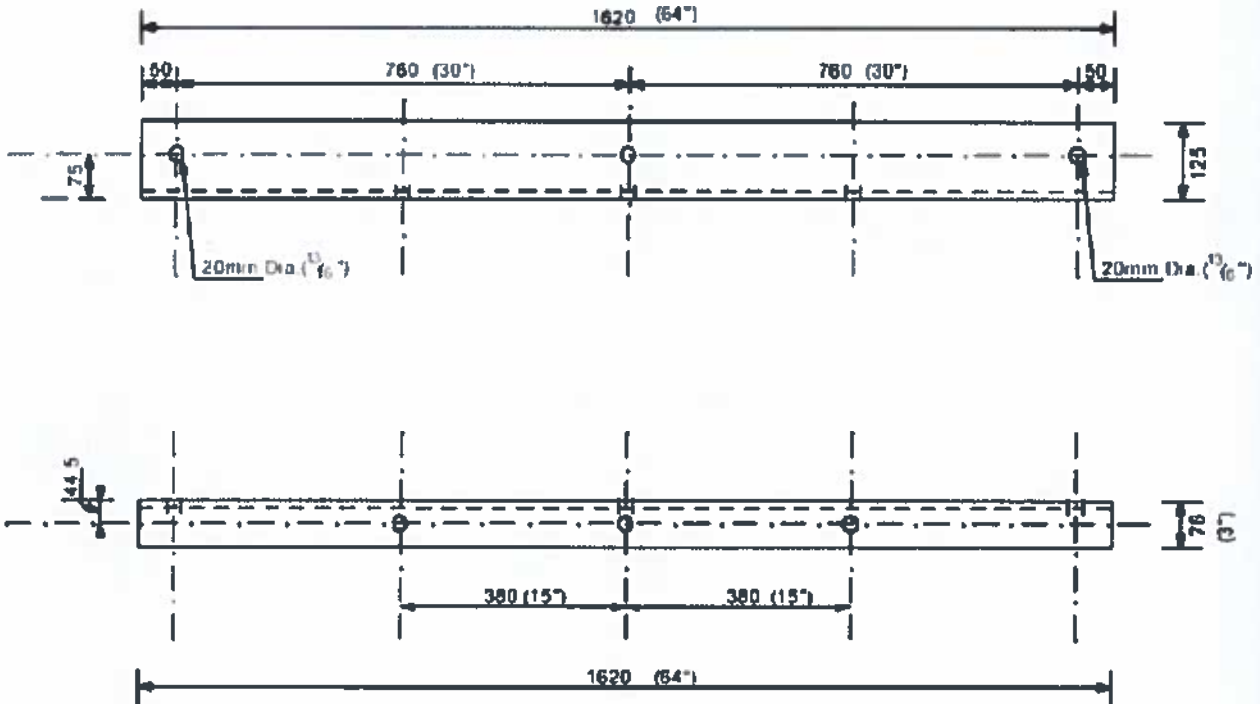

**FIG. 8B: 11kV TERMINAL CROSS ARM: KPLC CODE 182914** (L1620mm x 125mm x 76mm x 9.5mm structural steel angle, galvanized)

**Issued by: Head of Section , Standards Development**

**Authorized by: Manager, Standards**

**Signed:**



**Signed:**




**Date: 2015-08-10**

**Date: 2015-08-10**



TITLE:  
**SPECIFICATION FOR STEEL  
 STRUCTURES FOR OVERHEAD  
 LINES**


Doc. No.	KP1/6C/13/TSP/03/003
Issue No.	2
Revision No.	0
Date of Issue	2015-08-10
Page 24 of 33	

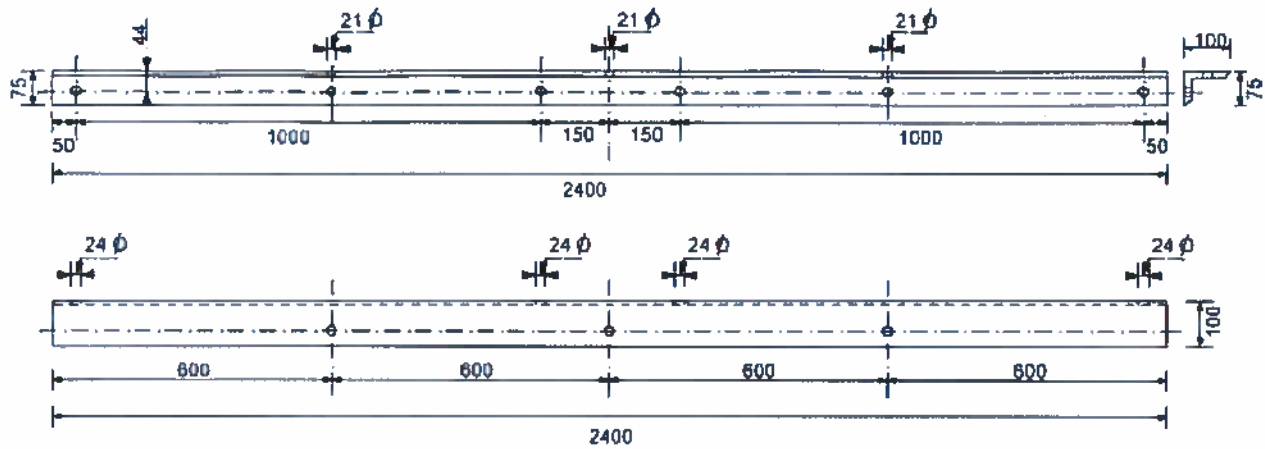

**FIG. 9: 33kV CROSS ARM: KPLC CODE 182960** (L2400mm x 100mm x 75mm x 9.5mm structural steel angle, galvanized)

Issued by: Head of Section , Standards Development	Authorized by: Manager, Standards
Signed:	Signed:
Date: 2015-08-10	Date: 2015-08-10



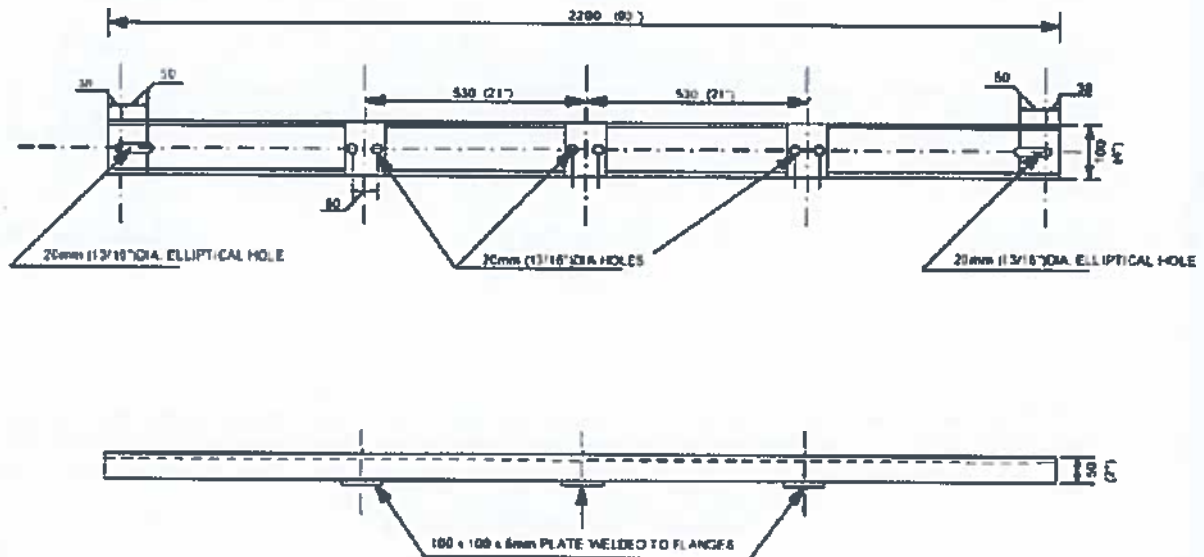

**FIG. 10: FUSE/SOLID LINK CROSS MEMBER CHANNEL: KPLC CODE 186925 - (U2290 x 100 x 50x6mm structural steel, galvanized) KPLC CODE 186926 - (U2290 x 125 x 64x6mm structural steel, galvanized)**

**Issued by: Head of Section , Standards Development**

**Authorized by: Manager, Standards**

**Signed:**




**Signed:**



**Date: 2015-08-10**

**Date: 2015-08-10**

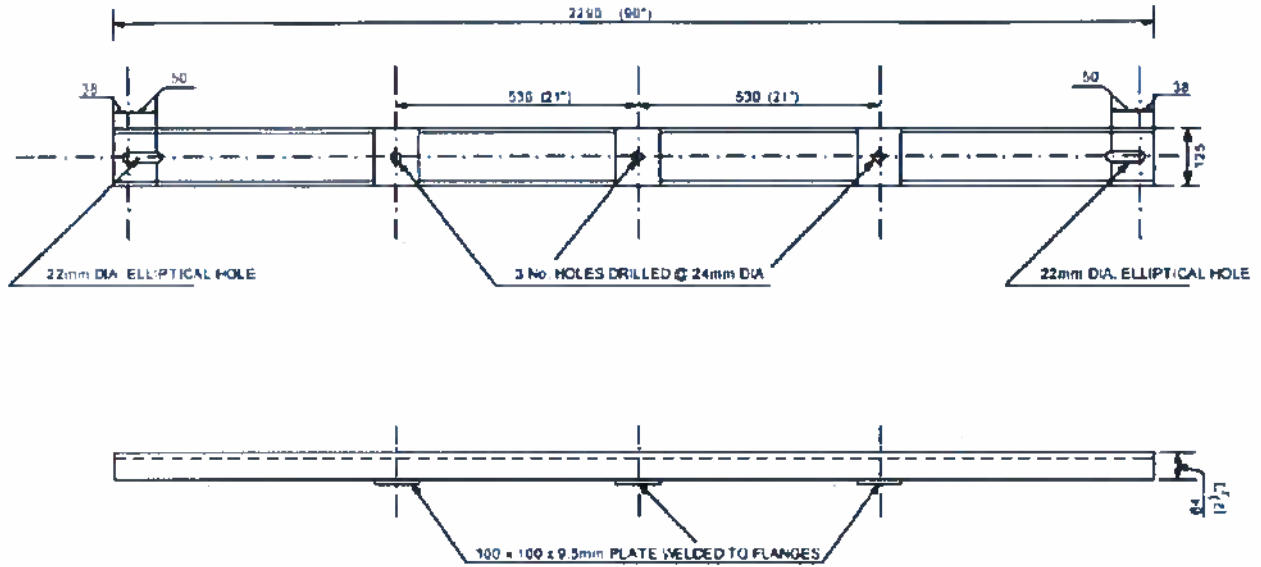

**FIG. 11: STEADY CROSS MEMBER**

**KPLC CODE 186921 FOR TX UP TO 200 KVA:** (U2290mm x 100mm x 50mm x 6mm structural steel, galvanized)

**KPLC CODE 186922 FOR TX 200 TO 315 KVA:** (U2290mm x 125mm x 64mm x 9.5mm structural steel, galvanized)

Issued by: Head of Section , Standards Development

Authorized by: Manager, Standards

Signed:



Signed:



Date: 2015-08-10

Date: 2015-08-10



TITLE:

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**


Doc. No. KP1/6C/13/TSP/03/003

Issue No. 2

Revision No. 0

Date of Issue 2015-08-10

Page 27 of 33

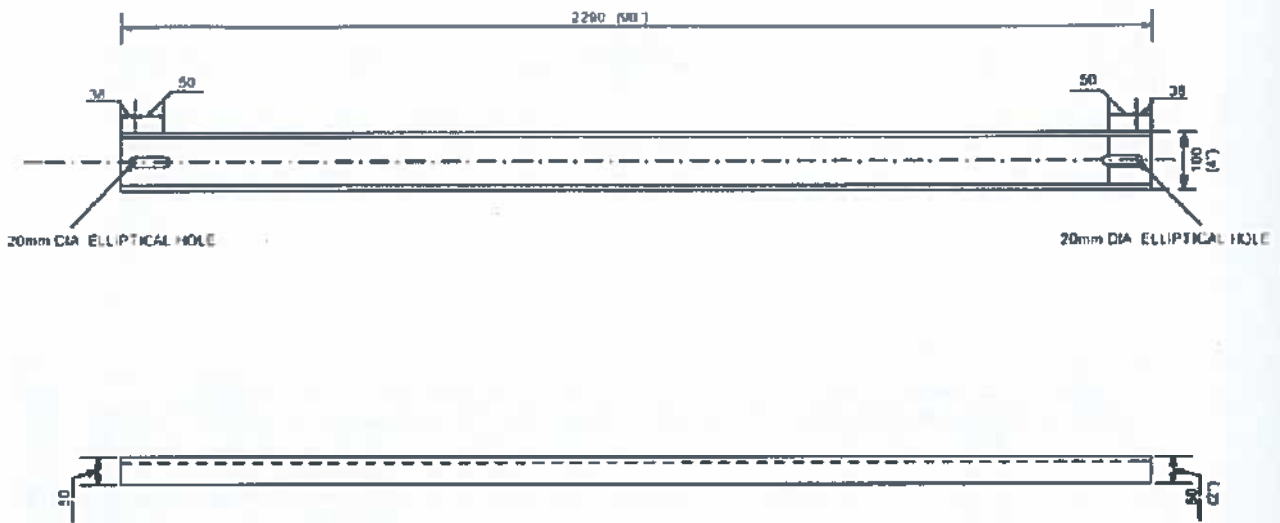

**FIG. 12: TRANSFORMER PLATFORM UP TO 200 KVA KPLC CODE 186923: (U2290mm x100mm x 50mm x 6mm structural steel, galvanized)**

Issued by: Head of Section , Standards Development


Authorized by: Manager, Standards

Signed:

Signed:

Date: 2015-08-10

Date: 2015-08-10

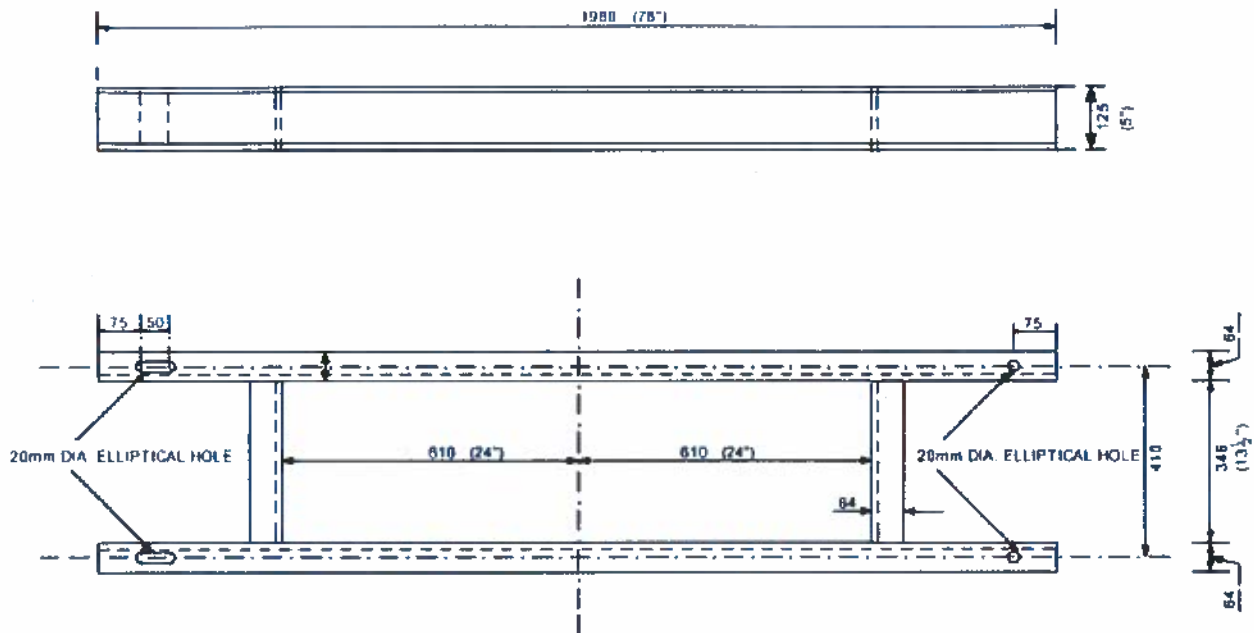

**FIG. 13A: TRANSFORMER PLATFORM 315 KVA KPLC CODE 186924 (1980mm x 125mm x 64mm x 6mm structural steel, galvanized) (To be complete with mounting brackets in Fig. 13B)**

Issued by: Head of Section , Standards Development

Authorized by: Manager, Standards

Signed:



Signed:



Date: 2015-08-10

Date: 2015-08-10

**TITLE:**

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**


**Doc. No.** KP1/6C/13/TSP/03/003

**Issue No.** 2

**Revision No.** 0



**Date of Issue** 2015-08-10



Page 29 of 33

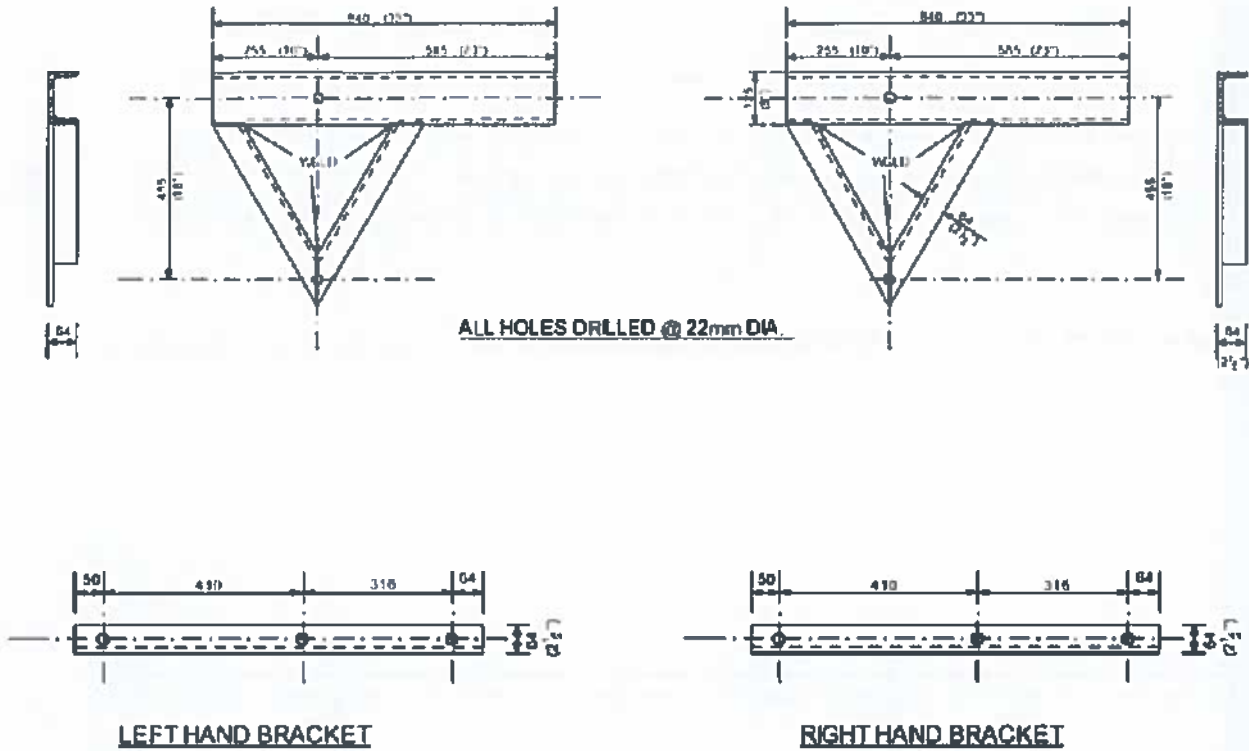

**FIG. 13B: MOUNTING BRACKETS FOR TRANSFORMER PLATFORM 315 KVA (see Fig 13A)**

(840mm x 125mm x 64mm x 6mm 'U' Channel structural steel, galvanized), (64mm x 64mm x 6mm structural steel angle, galvanized)

<b>Issued by:</b> Head of Section , Standards Development	<b>Authorized by:</b> Manager, Standards
<b>Signed:</b> 	<b>Signed:</b> 
<b>Date:</b> 2015-08-10	<b>Date:</b> 2015-08-10

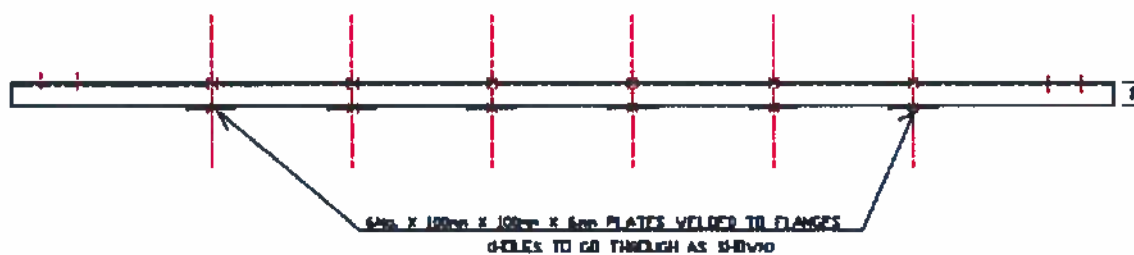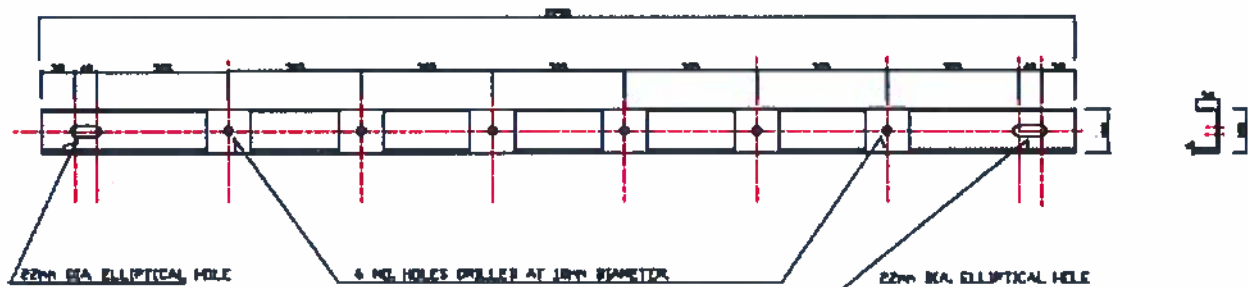

LV FUSE BAR, STEEL U- CHANNEL (2290mmX100mmX50mmX6mm)

DRG. No. KPLC/FB/CP/001

DATE: 15th September, 2005

**FIG. 14: LV FUSE BAR U-CHANNEL** (2290x100x50x6mm structural steel channel, galvanized), CODE 186927

Issued by: Head of Section , Standards Development

Authorized by: Manager, Standards

Signed:



Signed:



Date: 2015-08-10

Date: 2015-08-10

TITLE:

**SPECIFICATION FOR STEEL  
STRUCTURES FOR OVERHEAD  
LINES**


Doc. No. KP1/6C/13/TSP/03/003

Issue No. 2

Revision No. 0

Date of Issue 2015-08-10

Page 31 of 33

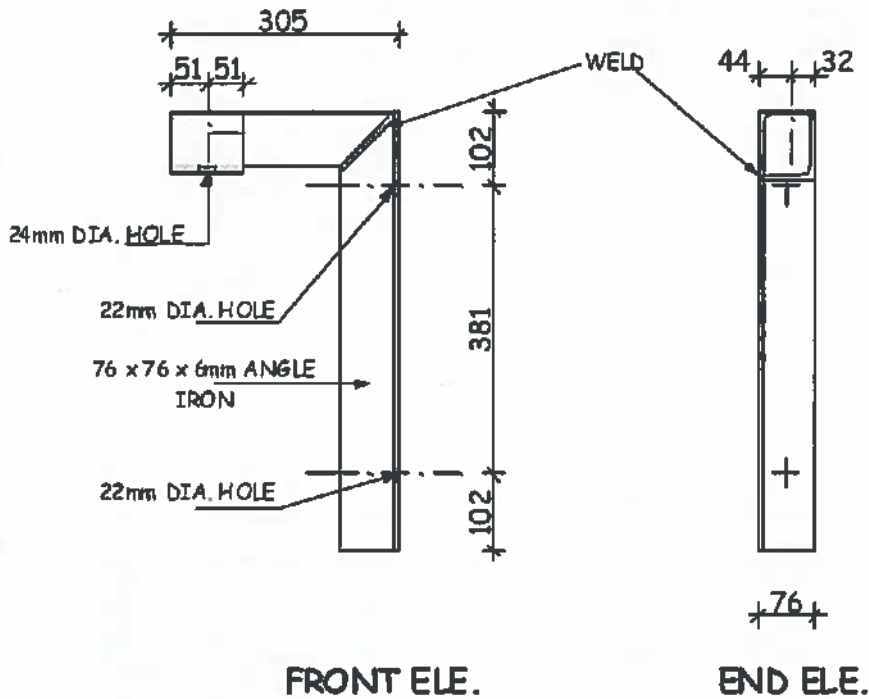

TITLE

**FIG. 15: CODE181228 -  
BRACKET TOP POLE 33KV DELTA CONS.**

CHECKED BY:

S. KIMITEI

Date:

D/Apr/07

DRAWN BY:

J. M.KAHARE

Date:

D/Apr/07

Issued by: Head of Section , Standards Development


Authorized by: Manager, Standards

Signed:

Date: 2015-08-10

Signed:

Date: 2015-08-10

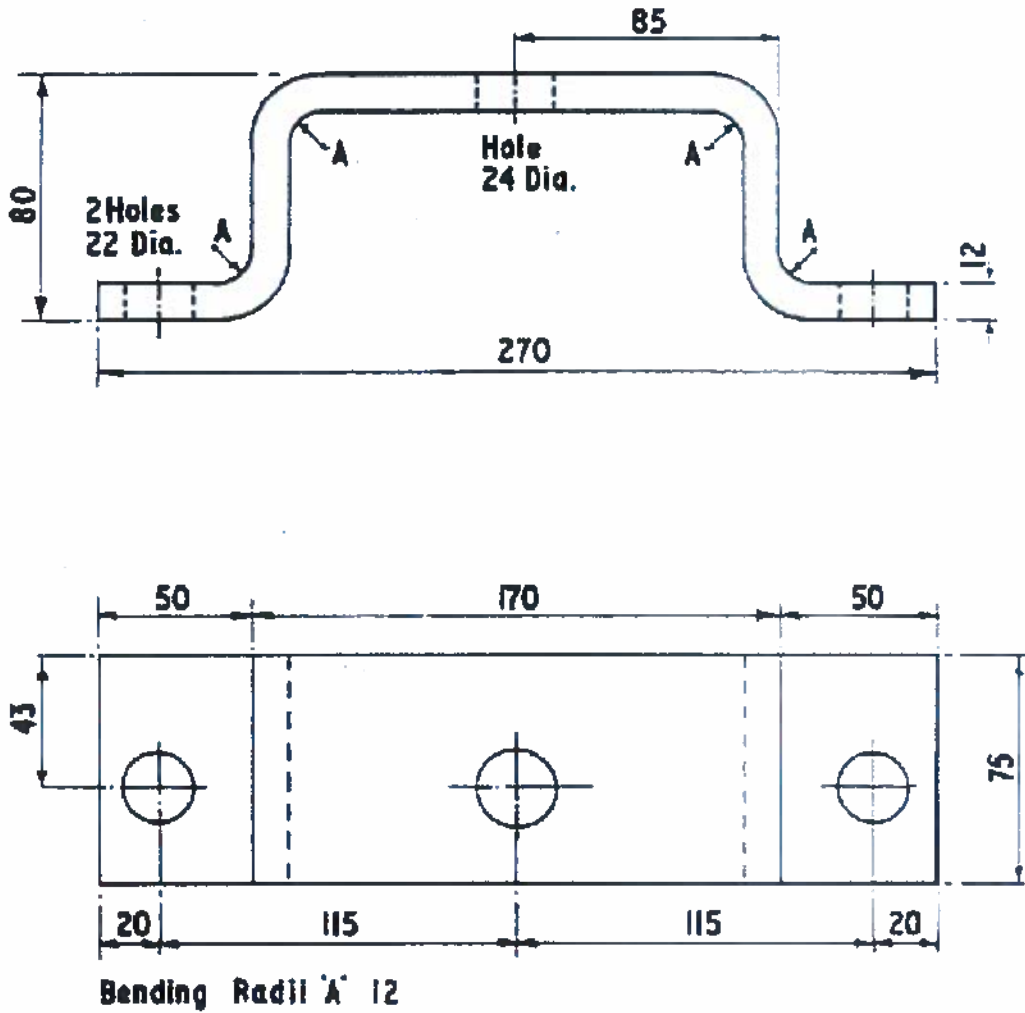

**FIG. 14: BRACKET INSULATOR - HV, - (structural steel, galvanized) CODE 186947**

Issued by: Head of Section , Standards Development

Authorized by: Manager, Standards

Signed:



Signed:



Date: 2015-08-10

Date: 2015-08-10



**TITLE:**

**SPECIFICATION FOR STEEL STRUCTURES FOR OVERHEAD LINES**


**Doc. No.** KP1/6C/13/TSP/03/003

**Issue No.** 2

**Revision No.** 0



**Date of Issue** 2015-08-10

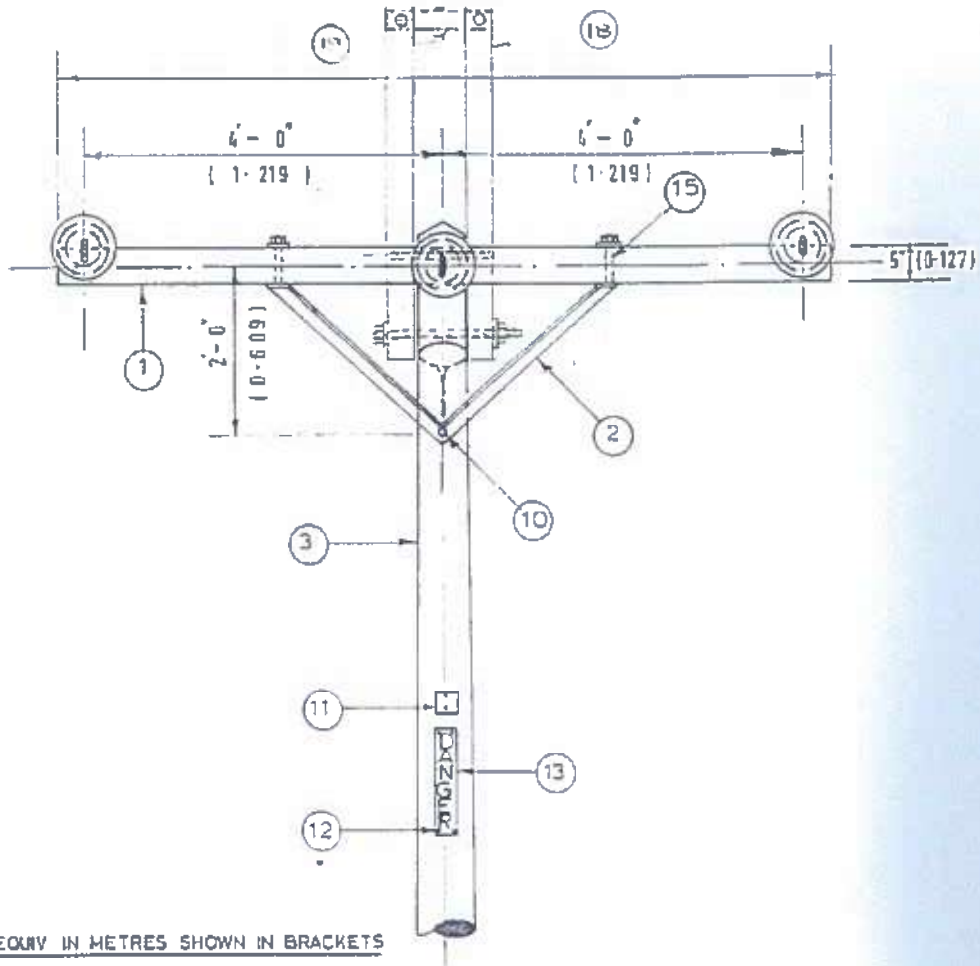Page 33 of 33



**FIG. 17: APPLICATION OF 33KV ANGLE TIE STRAP (item 2 in drawing, shown with wooden cross-arm - same item used on steel cross-arm)**

**NOTE: All dimensions are in millimetres unless otherwise stated for all the drawings in Annex B.**

Issued by: Head of Section , Standards Development	Authorized by: Manager, Standards
Signed: 	Signed: 
Date: 2015-08-10	Date: 2015-08-10

