


SECTION Z-Z

SECTION Y-Y

- NOTES**
- 1 Cover slab to be reinforced with Y10 bars both ways conc. class 20/20
  - 2 Base slab to be conc. class Mx 19/6
  - 3 Inlet & outlet pipes to be 100 mm Ø cast iron 200x100 at both end conc. 20/20
  - 4 Soak buffer to be 100mm thick reinforced with 200x100 at both end conc. 20/20
  - 5 dividing wall to be to be 100mm thick reinforced with weld-mesh.

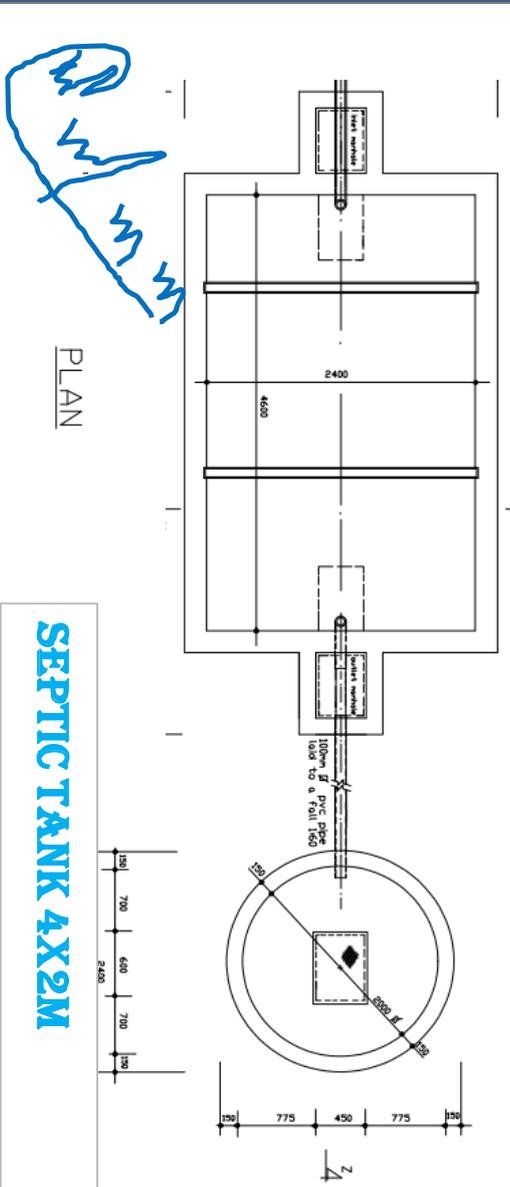

PLAN

**SEPTIC TANK 4X2M**

<b>PROJECT</b>	
<b>PROPOSED SEPTIC TANK AND SOAK PIT</b>	
<b>CLIENT</b>	
<b>FLUT</b>	
<b>DESCRIPTION</b>	
<b>PLAN AND CROSS SECTIONS</b>	
<b>DATE</b>	<b>NO.</b>
<b>2024/08/01</b>	<b>01</b>