
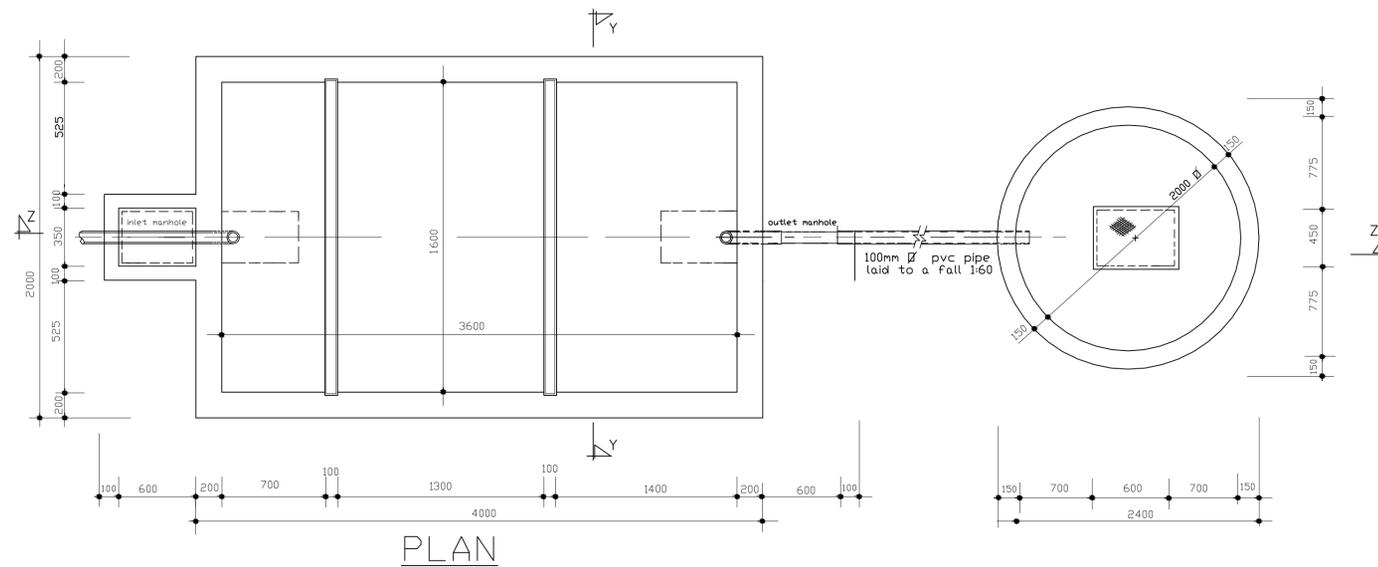
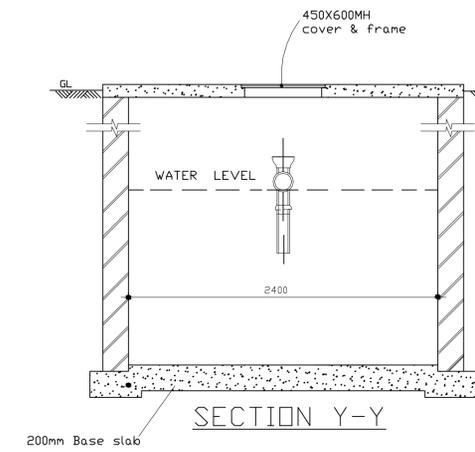


OIL INTERCEPTOR

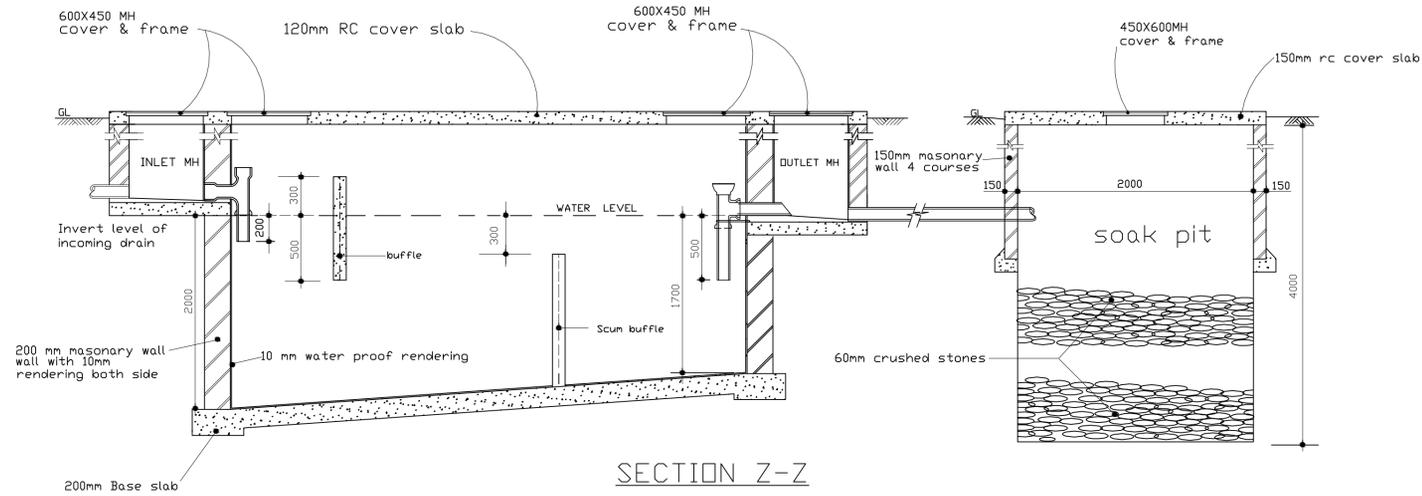

NOTES

- 1 Cover slab to be reinforced with Y10 bars both ways conc. class 20(20)
- 2 Base slab to be conc. class mix 1:3:6
- 3 Outlet & inlet pipes to be 100 mm Ø cast iron
- 4 Scum baffle to be 100mm thick reinforced with 2No.Y10 at both end conc. 20(20)
- 5 dividing wall to be to be 100mm thick reinforced with weld-mesh.

DATE	SIGN
APPROVED D.D.M.	DOMINIC MWANIKI
CHECKED ENGINEER I/C	
CHECKED P/D'MAN	
RE-DRAWN	
TRACED	

REF.	REVISION	DATE	SIGN	CHECKED	DATE
1					
2					
3					
4					
5					
6					

SEPTIC TANK & SOAKPIT

SCALE 1:25 UNLESS OTHERWISE STATED

Sheet 05

K. P. & L Co. LTD

SK. No. 11260